



Office of General Services

DESIGN & CONSTRUCTION GROUP
THE GOVERNOR NELSON A. ROCKEFELLER
EMPIRE STATE PLAZA
ALBANY, NY 12242

ADDENDUM NO. 1 TO PROJECT NO. 47161

CONSTRUCTION, HVAC & ELECTRICAL WORK PROVIDE BUILDING ENERGY EFFICIENCY IMPROVEMENTS DEC REGION 5 OFFICE 1115 NY-86 RAY BROOK, NY

October 2, 2026

NOTE: This Addendum forms a part of the Contract Documents. Insert it in the Project Manual. Acknowledge receipt of this Addendum in the space provided on the Bid Form.
--

BIDDING REQUIREMENTS - COMMON

1. DOCUMENT 001114 ADVERTISEMENT FOR BIDS: The last date for receipt of bids is changed from Wednesday, October 7, 2026, to Wednesday, October 21, 2026.

CONSTRUCTION WORK SPECIFICATIONS

2. SECTION 071416 COLD FLUID-APPLIED WATERPROOFING: Discard the Section bound in the Project Manual and substitute the accompanying Section (pages 071416 – 1 thru 071416 – 6) noted “ADDENDUM 1 – 9/30/2026”.

CONSTRUCTION WORK DRAWINGS

3. Revised Drawings:
 - a. Drawing Nos. C-102, C-103 and C-601, noted ADDENDUM 1, dated 9/30/2026, accompanies this Addendum and supersedes the same numbered previously issued drawings.

END OF ADDENDUM

Brady M. Sherlock, P.E.
Director, Division of Design
Design & Construction

SECTION 071416

COLD FLUID-APPLIED WATERPROOFING

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
 - 1. Polyurethane waterproofing.
- B. Scope of Work: Repairs and re-waterproofing resulting from damages to existing waterproofing materials due to construction activities.
- C. Related Requirements:
 - 1. Division 07 Section “Sheet Metal Flashings and Trim”
 - 2. Division 07 Section “Joint Sealants”

1.3 PREINSTALLATION MEETINGS

- A. Preinstallation Conference: Conduct conference at Project site.
 - 1. Review waterproofing requirements including, but not limited to, the following:
 - a. Surface preparation specified in other Sections.
 - b. Minimum curing period.
 - c. Forecasted weather conditions.
 - d. Special details and sheet flashings.
 - e. Repairs.
 - f. Field quality control.

1.4 ACTION SUBMITTALS

- A. Product Data: For each type of product.
 - 1. Catalog sheets, specifications, and installation instructions for each material specified.
 - 2. Include waterproofing manufacturer's recommended details for flashings, joint treatment, and required protection
 - 3. Include manufacturer's written instructions for evaluating, preparing, and treating substrate.

1.5 INFORMATIONAL SUBMITTALS

- A. Qualification Data: For Installer.
 - 1. Certifications: Submit a letter certifying that the membrane material meets the requirements listed in the specifications.
 - a. Certification that membrane material is compatible with existing substrates and waterproofing materials.
 - 2. Submit a letter certifying that the applicator has been actively installing waterproofing and/or roofing systems for the past 3 years
 - 3. Submit the names and addresses of 5 previous waterproofing and/or roofing projects. Include the type and size of each project, the waterproofing and/or roofing manufacturer's name, and the name and telephone number of a contact person at the project location.
 - 4. Submit a letter certifying that the supervisor or foreman and the workers applying the waterproofing materials have at least 3 years experience in the application of waterproofing and/or roofing materials.
- B. Field quality-control reports.
- C. Sample Warranties: For special warranties.

1.6 QUALITY ASSURANCE

- A. Installer/Applicator Qualifications: An entity that employs installers and supervisors who are trained and approved by waterproofing manufacturer.
 - 1. The waterproofing applicator must have been actively installing waterproofing and/or roofing systems for the past 3 years
 - 2. The waterproofing applicator must have previously installed and completed a minimum of 5 waterproofing and/or roofing projects of comparable scope and complexity to the Work of this Section.
 - 3. The person supervising the Work of this Section and the workers applying the waterproofing materials shall have had at least 3 years of experience in the application of waterproofing and/or roofing materials.
- B. Pre-Installation Conference: Before the membrane Work is scheduled to commence, a conference will be called by the Director's Representative at the Site for the purpose of reviewing the Drawings, Specifications, Existing Conditions, Schedule and work that may damage existing foundation waterproofing membranes and systems. The conference shall be attended by the Contractor, approved applicator, and the manufacturer's representative

1.7 DELIVERY, STORAGE AND HANDLING

- A. Deliver products in manufacturer's original containers, with seals and labels intact.
- B. Store materials off ground, in enclosed space, protected from weather and out of direct rays of sun.
- C. Maintain manufacturer's recommended storage temperature.

1.8 FIELD CONDITIONS

- A. Environmental Limitations: Apply waterproofing within the range of ambient and substrate temperatures recommended in writing by waterproofing manufacturer.
 - 1. Do not apply waterproofing to a damp or wet substrate, when relative humidity exceeds 85 percent, or when temperatures are less than 5 deg F (3 deg C) above dew point.
 - a. Do not mix or apply waterproofing materials when air or deck temperatures are less than 40 degrees F or more than 100 degrees F, unless otherwise instructed in writing by the manufacturer.
 - b. Do not spray waterproofing materials during winds over 10 mph unless otherwise approved in writing by the Director's Representative.
 - 2. Do not apply waterproofing in snow, rain, fog or mist, or when such weather conditions are imminent during application and curing period.
- B. Maintain adequate ventilation during application and curing of waterproofing materials.

1.9 WARRANTY

- A. Manufacturer's Special Warranty: Manufacturer agrees to repair or replace waterproofing that fails in materials or workmanship within specified warranty period.
 - 1. Warranty Period: Five years from date of Substantial Completion.
- B. Installer's Special Warranty: Signed by Installer, covering Work of this Section, for warranty period of two years.
 - 1. Warranty includes removing landscaping, fill and earth as required to uncover and access areas of suspected deficiencies.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

- A. Source Limitations for Waterproofing System: Obtain waterproofing materials and accessory materials from single source from single manufacturer.

2.2 SINGLE-COMPONENT POLYURETHANE WATERPROOFING

- A. Single-Component, Modified Polyurethane Waterproofing Basis of Design: ASTM C 836/C 836M and coal-tar free, 100% solids, fluid applied, moisture reacted, elastomeric, solvent free, waterproof membrane for vertical and horizontal surfaces: MiraSEAL as manufactured by Carlisle Coatings and Waterproofing or a comparable product by, but not limited to, one of the following manufacturers:
 - 1. Basis of Design: Tremco TREMproof 250GC as manufactured by Tremco Inc. or a comparable product by, but not limited to, one of the following manufacturers:

2. Other manufacturer's products: Mapei Planiseal CR1 or Sikalastic HLM 5000 GC.
3. Contractor to confirm compatibility with existing substrates and waterproofing.
4. Composition: Modified Polymer
5. Solids Content: 100% as per ASTM 2697
6. Low Temperature Flexibility: No Cracking as per ASTM C836
7. Low Temperature Crack Bridging: No Cracking as per ASTM C836
8. Elongation: 350% as per ASTM D2370
9. Tensile Strength: 95 psi as per ASTM D2370
10. Water Vapor Transmission rate: 0.06 perms inches as per ASTM E96

2.3 AUXILIARY MATERIALS

- A. General: Provide auxiliary materials recommended in writing by waterproofing manufacturer for intended use and compatible with one another and with waterproofing.
 1. Furnish liquid-type auxiliary materials that comply with VOC limits of authorities having jurisdiction.
- B. Primer: Manufacturer's standard primer, sealer, or surface conditioner; factory-formulated, for elastomeric membrane and substrates encountered at the site.
- C. Static Joint and Crack Filler: Use materials recommended by the manufacturer of the elastomeric membrane.
- D. Expansion Joint Filler and Back-up Rod: As specified in Division 07 Section "Joint sealants."
- E. Joint Sealant Type 10: Multicomponent polyurethane sealant, compatible with waterproofing; ASTM C 920, Type M, Class 25 or greater; Grade NS for sloping and vertical applications and Grade P for deck applications; Use NT exposure and as specified in Section 079200 "Joint Sealants" and as recommended by manufacturer for substrate and joint conditions.
 1. Backer Rod: Closed-cell polyethylene foam.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine substrates, areas, and conditions, with Installer present, for compliance with requirements and other conditions affecting performance of the Work.
 1. Verify that concrete has cured and aged for minimum time period recommended in writing by waterproofing manufacturer.
 2. Verify that substrate is visibly dry and within the moisture limits recommended in writing by manufacturer. Test for capillary moisture by plastic sheet method according to ASTM D 4263.
 3. Verify that all fins and ridges have been removed and that all other surface defects have been corrected.
 4. Verify that all openings around penetrations such as pipes, vents and structural members are sealed to prevent entry of waterproofing material.

- B. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 PREPARATION

- A. Clean, prepare, and treat substrates according to manufacturer's written instructions. Provide clean, dust-free, and dry substrates for waterproofing application.
- B. Verify that all openings around penetrations such as pipes, vents and structural members are sealed to prevent entry of waterproofing material.
- C. Mask off adjoining surfaces not receiving waterproofing to prevent spillage and overspray affecting other construction.
- D. Remove grease, oil, bitumen, form-release agents, paints, curing compounds, acid residues, and other penetrating contaminants or film-forming coatings from concrete.
- E. Remove fins, ridges, and other projections, and fill honeycomb, aggregate pockets, holes, and other voids.
- F. Patch all areas of the existing substrate that have been damaged by removals. Remove loose materials and fill voids to obtain a reasonably smooth surface for proper bonding of the waterproofing materials. Use patching materials recommended by the elastomeric membrane manufacturer.
- G. Follow the written instructions of the elastomeric membrane manufacturer; unless otherwise specified:
 - 1. Fill static joints and cracks.

3.3 PREPARATION AT TERMINATIONS, PENETRATIONS, AND CORNERS

- A. Apply waterproofing in two separate applications, and embed a joint reinforcing strip in the first preparation coat when recommended by waterproofing manufacturer.

3.4 JOINT AND CRACK TREATMENT

- A. Prepare, treat, rout, and fill joints and cracks in substrate according to waterproofing manufacturer's written instructions and to recommendations in **ASTM C 898/C 898M and ASTM C 1471/C 1471M**. Before coating surfaces, remove dust and dirt from joints and cracks according to ASTM D 4258.
 - 1. Comply with ASTM C 1193 for joint-sealant installation.
 - 2. Apply bond breaker on sealant surface, beneath preparation strip.
 - 3. Prime substrate along each side of joint and apply a single thickness of preparation strip at least 6 inches (150 mm) wide along each side of joint. Apply waterproofing in two separate applications and embed a joint reinforcing strip in the first preparation coat.

3.5 WATERPROOFING APPLICATION

- A. Apply waterproofing according to manufacturer's written instructions and to recommendations in **ASTM C 898/C 898M and ASTM C 1471/C 1471M**.

- B. Start installing waterproofing in presence of manufacturer's technical representative.
- C. Apply primer over prepared substrate unless otherwise instructed in writing by waterproofing manufacturer.
- D. Unreinforced Waterproofing Applications: Mix materials and apply waterproofing by spray, roller, notched squeegee, trowel, or other application method suitable to slope of substrate.
 - 1. Application Method: Use spray, roller, squeegee, trowel, or brush as recommended by the manufacturer and as necessary to produce the specified waterproof system.
 - 2. Apply one or more coats of waterproofing to obtain a seamless membrane free of entrapped gases and pinholes, with a dry film thickness of **60 mils (1.5 mm)** with no variations under 50 mils.
 - 3. Apply waterproofing to prepared wall terminations and vertical surfaces.
 - 4. Verify manufacturer's recommended wet film thickness of waterproofing every 100 sq. ft. (9.3 sq. m).
- E. Flashings: At all intersections with vertical surfaces (walls, pipes, mechanical units, structural members etc.) turn the membrane up to form a waterproof pan. Form integral flashings consisting of a double thickness (120 mils) of elastomeric membrane applied over a cant; or install flashings in conformance with the manufacturer's details.
- F. Expansion Joints: After installation of sealant and bond breaker (each side of joint) apply a 12 inch wide double thickness (120 mils) of elastomeric membrane, centered over the joint, or cover expansion joint in conformance with the manufacturer's details.
- G. Cure waterproofing, taking care to prevent contamination and damage during application and curing.

3.6 FIELD QUALITY CONTROL

- A. Thickness of Membrane:
 - 1. During application, take frequent wet gage checks to assure sufficient coverage to obtain the specified dry film thickness.
 - 2. When and where directed by the Director's Representative, make test cuts thru the cured membrane and measure the dry film thickness. (Up to one test for each 100 sf may be required). Patch the cuts immediately with matching materials. Apply additional membrane material where required, if tests show less than specified membrane thickness.

3.7 PROTECTION

- A. Protect waterproofing from damage and wear during remainder of construction period.
- B. Correct deficiencies in or remove waterproofing that does not comply with requirements; repair substrates, reapply waterproofing, and repair sheet flashings.

END OF SECTION 071416



NOTES:

1. COORDINATE THE LOCATION OF EXCAVATED STOCKPILE MATERIAL WITH THE DIRECTOR'S REPRESENTATIVE. USE STABILIZED SOIL STOCKPILE AND COMPOST FILTER SOCK DETAILS.
2. DEWATERING PLAN FOR THE EXCAVATION OF THE BORE FIELD SHALL BE PERFORMED UNDER H-CONTRACT.
3. ASPHALT COURSES REMOVAL OF THE PARKING LOT SHALL BE PERFORMED UNDER C-CONTRACT.
4. REFER TO DRAWING S-500 FOR DETAILS RELATED TO THE GENERATOR PADS, GENERATORS AND ASSOCIATED EQUIPMENT TO BE INSTALLED UNDER E-CONTRACT.
5. REFER TO DRAWING S-500 FOR DETAILS RELATED TO THE SWITCHBOARD PAD, SWITCHBOARD AND ASSOCIATED EQUIPMENT TO BE INSTALLED UNDER E-CONTRACT.
6. REFER TO DRAWING S-500 FOR DETAILS RELATED TO THE PROPANE TANK VAPORIZER PADS, PROPANE TANK VAPORIZERS AND ASSOCIATED EQUIPMENT TO BE INSTALLED UNDER H-CONTRACT.

SHEET SIZE 30" x 42". DRAWING IS NOT TO SCALE
WHEN PRINTED IN ALL OTHER SHEET SIZES.



EROSION CONTROL LINE LEGEND	
SYMBOL	ITEM
---	CONTRACT LIMIT LINE
---	COMPOST FILTER SOCK

MATERIALS LEGEND	
SYMBOL	ITEM
[Hatched Box]	LIMIT OF ASPHALT REMOVAL AND REPLACEMENT
[Stippled Box]	LIMIT OF TOPSOIL AND SEED
[Dotted Box]	LIMIT OF CONCRETE REMOVAL AND REPLACEMENT

NOTES:

1. CONTRACTOR STAGING LIMITS FOR EXTERIOR WORK SHALL BE CONFINED WITHIN THE LIMITS OF THE TEMPORARY CONSTRUCTION FENCE.

2. C CONTRACT IS RESPONSIBLE FOR REMOVAL AND DISPOSAL OF ASPHALT PAVEMENT, PAVEMENT SUBBASE, SIDEWALK, AND SIDEWALK SUBBASE WITHIN THE LIMITS OF DISTURBANCE SHOWN ON THE DRAWINGS. LIMIT OF EXCAVATION SHALL BE GRADED TO ACCOMMODATE INSTALLATION OF BORE HOLES, PIPING, AND ASSOCIATED UTILITIES. WORK RELATED TO THE INSTALLATION OF THE BORINGS AND PIPING WILL BE PERFORMED UNDER THE H CONTRACT. ASSOCIATED ELECTRICAL WORK WILL BE PERFORMED UNDER THE E CONTRACT.

DESIGN & CONSTRUCTION

CONSULTANT:

CERTIFICATE OF AUTHORIZATION # 018342

CERTIFICATE OF AUTHORIZATION # 022086

a better environment

UNIFORM CODE STATEMENT:
TO THE BEST OF THE REGISTERED DESIGN PROFESSIONAL'S KNOWLEDGE, BELIEF, AND PROFESSIONAL JUDGEMENT, THESE PLANS AND/OR SPECIFICATIONS ARE IN COMPLIANCE WITH THE 2020 UNIFORM CODE.

ENERGY CODE COMPLIANCE STATEMENT:
TO THE BEST OF THE REGISTERED DESIGN PROFESSIONAL'S KNOWLEDGE, BELIEF, AND PROFESSIONAL JUDGEMENT, THESE PLANS AND/OR SPECIFICATIONS ARE IN COMPLIANCE WITH THE 2020 ENERGY CODE.

WARNING:
THE ALTERATION OF THIS MATERIAL, IN ANY WAY, UNLESS DONE UNDER THE DIRECTION OF A COMPETENT PROFESSIONAL, I.E. ARCHITECT FOR AN ARCHITECT, ENGINEER FOR AN ENGINEER OR LANDSCAPE ARCHITECT FOR A LANDSCAPE ARCHITECT, IS A VIOLATION OF THE NEW YORK STATE EDUCATION LAW AND/OR REGULATIONS AND IS A CLASS B MISDEMEANOR.

PROJECT NORTH

REGISTRATION EXPIRES: 12/31/2028

CONTRACT: CONSTRUCTION

TITLE: PROVIDE BUILDING ENERGY EFFICIENCY IMPROVEMENTS

LOCATION: DEC REGION 5 HEADQUARTERS
1115 NY-86
RAY BROOK, NY

CLIENT: DEPARTMENT OF ENVIRONMENTAL CONSERVATION


1	2026-09-30	ADDENDUM 1
	2026-06-24	BID DOCUMENTS

MARK	DATE	DESCRIPTION
PROJECT NUMBER:		47161-C
DESIGNED BY:	JLB	
DRAWN BY:	JLB	
FIELD CHECK:	ZR	
APPROVED:	JH	


SHEET TITLE:
EROSION AND SEDIMENT CONTROL AND SITE RESTORATION PLAN

DRAWING NUMBER:
C-103

SHEET: 25 OF 76

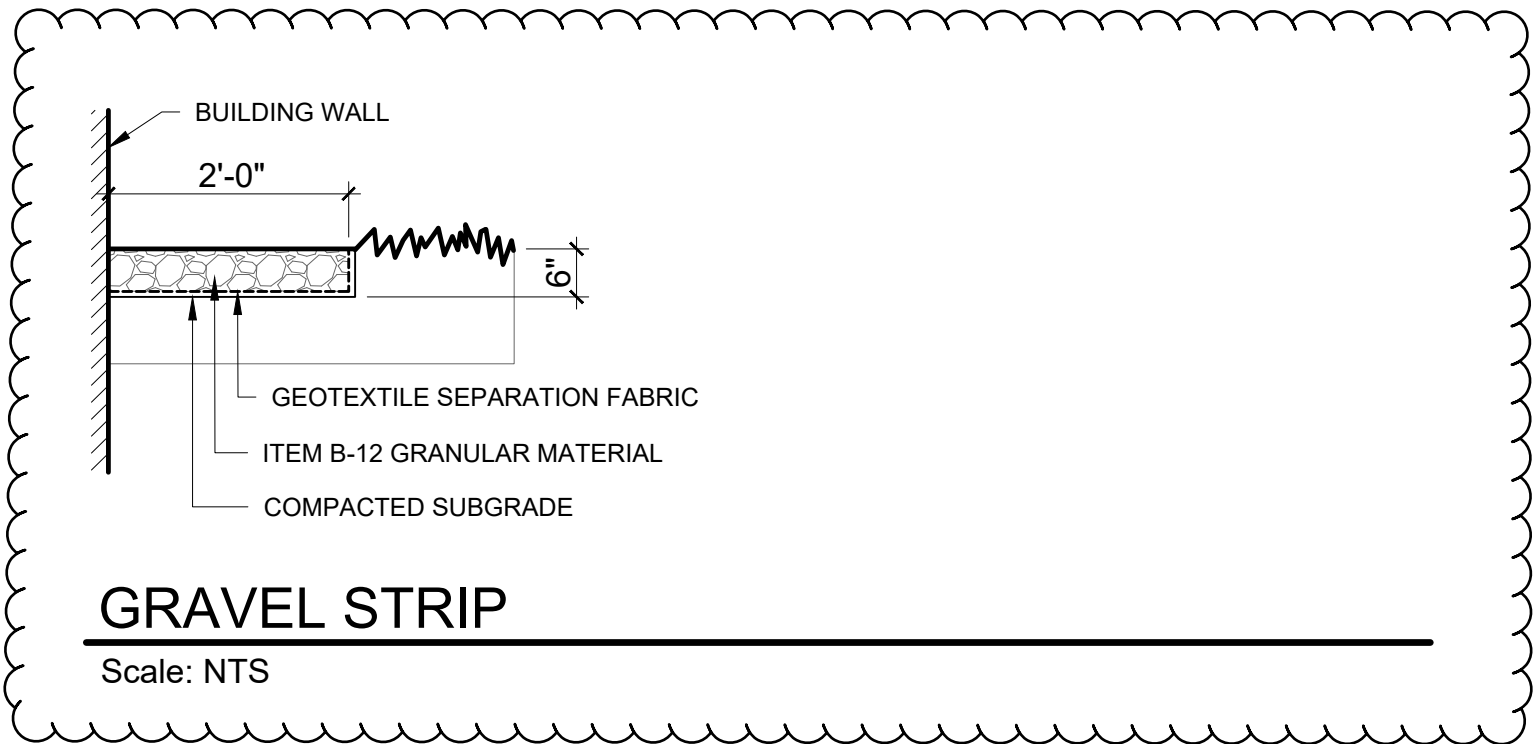

GRAVEL STRIP
Scale: NTS

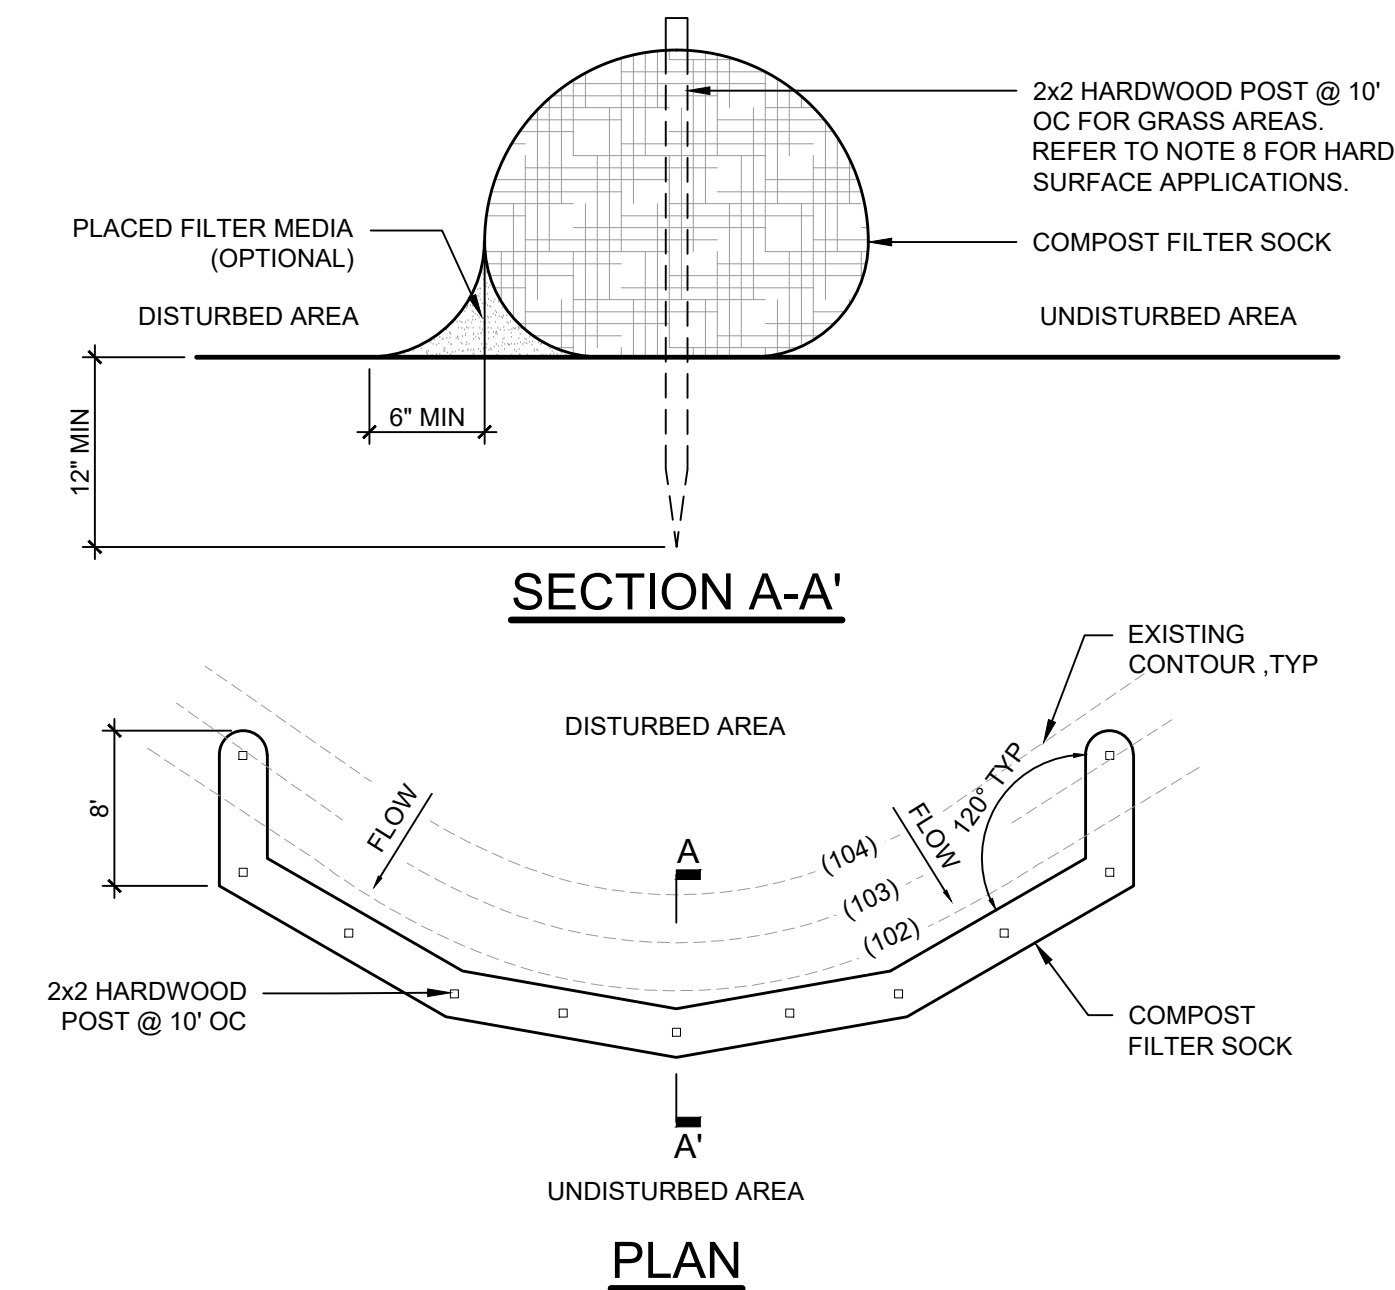

NOTE:

1. COMPOST FILTER SOCKS SHALL BE PLACED ON THE CONTOUR WITH BOTH TERMINAL ENDS OF THE SOCK EXTENDED 8 FEET UPSLOPE AT A 45° ANGLE TO PREVENT BYPASS FLOW.
2. DIAMETERS DESIGNED FOR USE SHALL BE 12"-32"
3. THE FLAT DIMENSION OF THE SOCK SHALL BE AT LEAST 1.5 TIMES THE NOMINAL DIAMETER.
4. THE MAXIMUM SLOPE LENGTH (IN FEET) ABOVE A COMPOST FILTER SOCK SHALL NOT EXCEED THE FOLLOWING LIMITS:

TABLE 1 - MAXIMUM SLOPE LENGTH ABOVE COMPOST FILTER SOCK (FEET)								
DIA (IN)	SLOPE %							
	2	5	10	20	25	33	50	
8	225	200	100	5	20	-	-	
12	250	225	125	65	50	40	25	
18	275	250	150	70	55	45	30	
24	350	275	200	130	100	60	35	
32	450	325	275	150	120	75	50	

TABLE 2 - COMPOST FILTER MEDIA STANDARDS	
ORGANIC MATTER CONTENT	25% - 100% DRY WEIGHT
ORGANIC PORTION	FIBROUS AND ELONGATED
pH	6.0 - 8.0
MOISTURE CONTENT	30% - 60%
PARTICLE SIZE	100% PASSING A 1" SCREEN AND 10-50% PASSING A 3/8" SCREEN
SOLUBLE SALT CONCENTRATION	5.0 dS/m (mmhos/cm) MAXIMUM


TABLE 3 - COMPOST SOCK FABRIC MINIMUM SPECIFICATIONS					
MATERIAL TYPE	3 MIL HDPE	5 MIL HDPE	5 MIL HDPE	MULTI-FILAMENT POLYPROPYLENE	HEAVY DUTY MULTI-FILAMENT POLYPROPYLENE
MATERIAL CHARACTERISTICS	PHOTODEGR AD-ABLE	PHOTODEGR AD-ABLE	BIODEGR AD-ABLE	PHOTODEGRAD-ABLE	PHOTODEGRAD-ABLE
SOCK DIAMETERS	12", 18"	12", 18", 24", 32"	12", 18", 24", 32"	12", 18", 24", 32"	12", 18", 24", 32"
MESH OPENING	3/8"	3/8"	3/8"	3/8"	1/8"
TENSILE STRENGTH		26 PSI	26 PSI	44 PSI	202 PSI
ULTRAVIOLET STABILITY % ORIGINAL STRENGTH (ASTM G-155)	23% AT 1000 HR.	23% AT 1000 HR.		100% AT 1000 HR.	100% AT 1000 HR.
MINIMUM FUNCTIONAL LONGEVITY	6 MONTHS	9 MONTHS	6 MONTHS	1 YEAR	2 YEARS

5. THE COMPOST INFILL SHALL BE WELL DECOMPOSED (MATURED AT LEAST 3 MONTHS), WEED-FREE, ORGANIC MATTER. IT SHALL BE AEROBICALLY COMPOSTED, POSSESS NO OBJECTIONABLE ODORS, AND CONTAIN LESS THAN 1% BY DRY WEIGHT, OF MAN-MADE FOREIGN MATTER. THE PHYSICAL PARAMETERS OF THE COMPOST SHALL MEET THE STANDARDS LISTED IN TABLE 5.2-COMPOST FILTER MEDIA STANDARDS TABLE. NOTE: ALL BIOSOLIDS COMPOST PRODUCED IN NEW YORK STATE (OR APPROVED FOR IMPORTATION) MUST MEET NYS DEC'S 6 NYCRR PART 360 (SOLIDS WASTE MANAGEMENT FACILITIES) REQUIREMENTS. THE PART 360 REQUIREMENTS ARE EQUAL TO OR MORE STRINGENT THAN 40 CFR PART 503 WHICH ENSURE SAFE STANDARDS FOR PATHOGEN REDUCTION AND HEAVY METALS CONTENT. WHEN USING COMPOST FILTER SOCKS ADJACENT TO SURFACE WATER, THE COMPOST SHOULD HAVE A LOW NUTRIENT VALUE.
6. THE COMPOST FILTER SOCK FABRIC MATERIAL SHALL MEET THE MINIMUM SPECIFICATIONS GIVEN IN TABLE 5.3-COMPOST SOCK FABRIC MINIMUM SPECIFICATIONS TABLE.
7. COMPOST FILTER SOCKS SHALL BE ANCHORED IN EARTH WITH 2x2 WOODEN STAKES DRIVEN 12" INTO THE SOIL ON 10 FOOT CENTER ON THE CENTERLINE OF THE SOCK. ON UNEVEN TERRAIN, EFFECTIVE GROUND CONTACT CAN BE ENHANCED BY THE PLACEMENT OF A FILLET OR FILTER MEDIA ON THE DISTURBED AREA SIDE OF THE COMPOST SOCK.
8. FOR HARD SURFACE APPLICATIONS, A SECOND COMPOST FILTER SOCK SHALL BE USED IN LIEU OF WOODEN STAKE.
9. ALL SPECIFIC CONSTRUCTION DETAILS AND MATERIAL SPECIFICATIONS SHALL APPEAR ON THE EROSION AND SEDIMENT CONTROL CONSTRUCTIONS DRAWINGS WHEN COMPOST FILTER SOCKS ARE INCLUDED IN THE PLAN.

*TABLE FROM THE 2016 NYS STANDARDS AND SPECIFICATIONS FOR EROSION AND SEDIMENT CONTROL.

COMPOST FILTER SOCK

Scale: NTS TEMPORARY

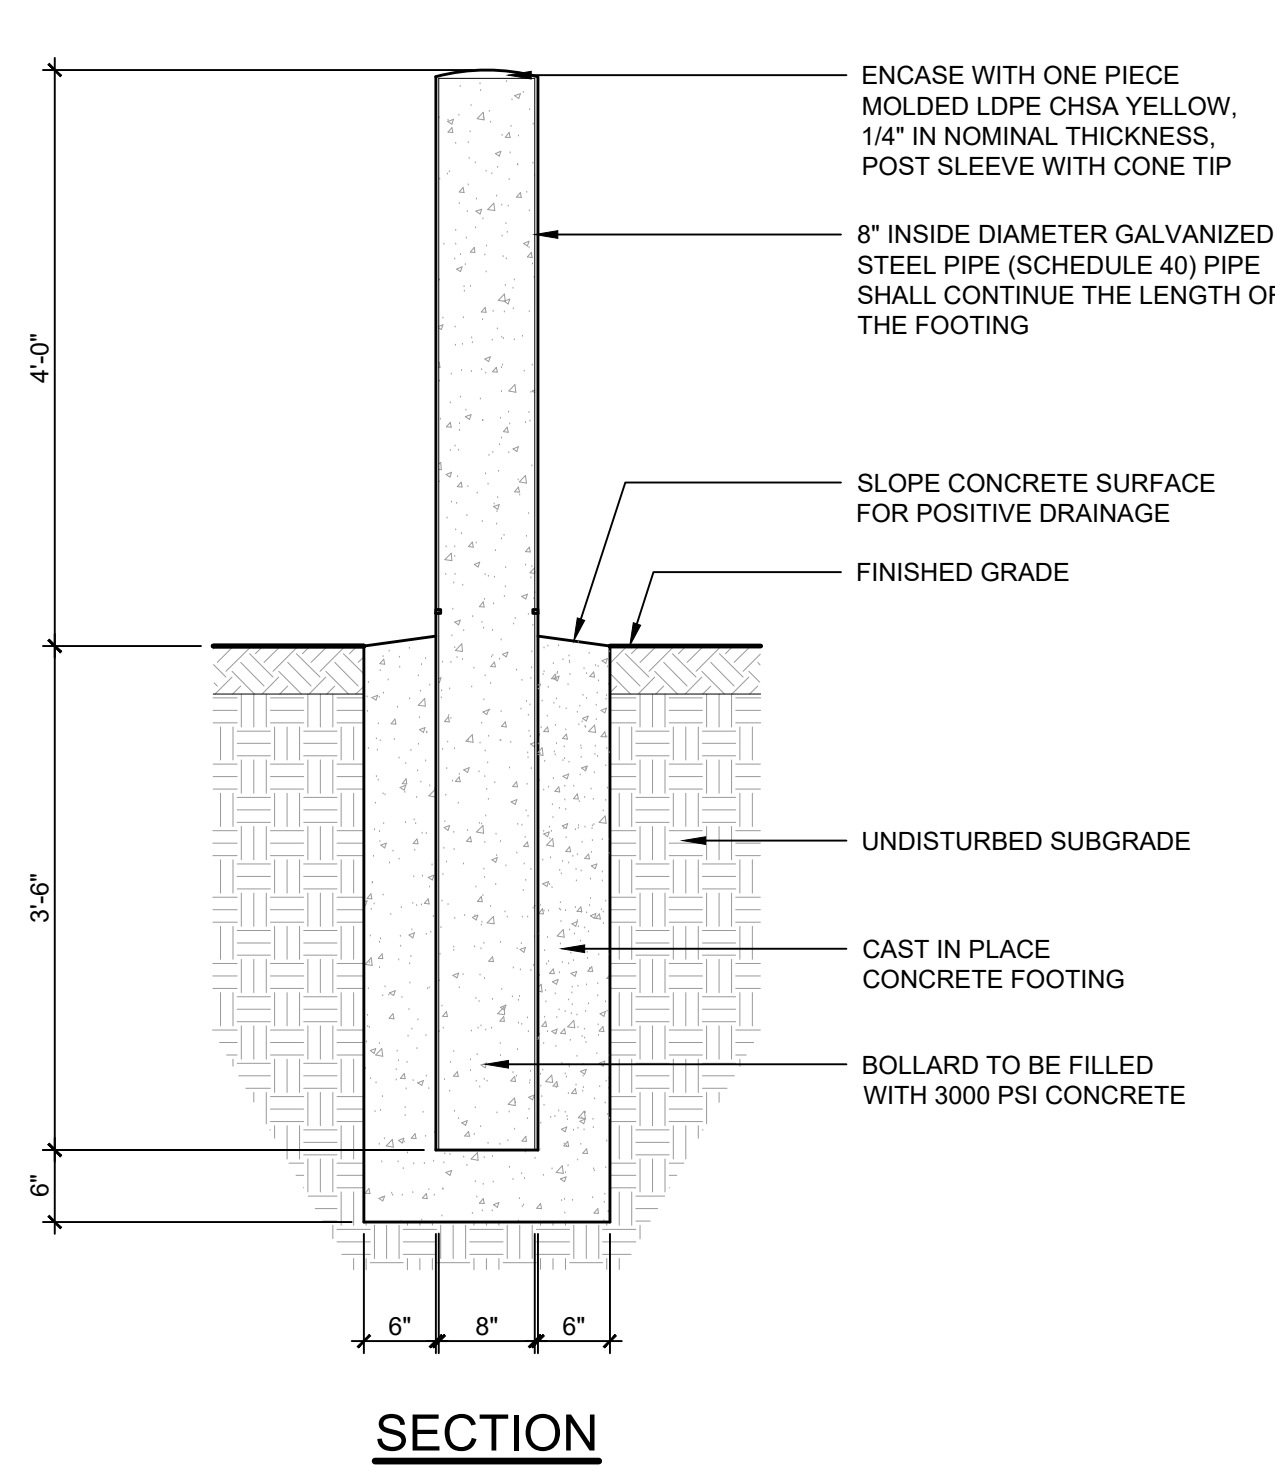


SECTION

NOTES:

1. ALL CONCRETE SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 3,000 PSI AT 28 DAYS.
2. ALL CONCRETE SHALL HAVE A 5% ENTRAINED AIR (WITH A TOLERANCE OF 1%) CONFIRMING WITH ASTM C250.

STEEL PIPE BOLLARD

Scale: NTS

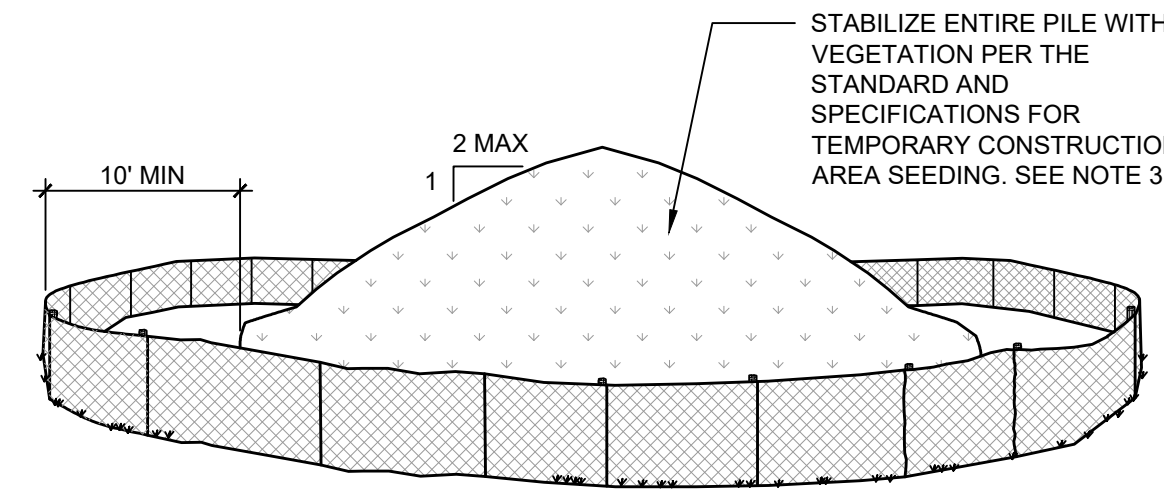


NOTES:

1. AREA CHOSEN FOR STOCKPILING OPERATIONS SHALL BE DRY, STABILIZED AND LOCATED AWAY FROM KNOWN WORK AREAS TO PREVENT RELOCATION.
2. MAXIMUM STOCKPILE HEIGHT SHALL BE 12 FEET.
3. EACH PILE SHALL BE SURROUNDED WITH SILT FENCE, INSTALLED PER SPECIFICATIONS, THEN STABILIZED IN ACCORDANCE WITH THE NYSDEC STANDARD AND SPECIFICATIONS FOR TEMPORARY CONSTRUCTION AREA SEEDING WITHIN 7 DAYS OF COMPLETION.
4. A PERIMETER DIKESWALE SHALL BE LOCATED UP-SLOPE OF THE TOPSOIL STOCKPILE TO DIVERT STORMWATER AROUND THE STOCKPILE, IF APPLICABLE.


STABILIZED SOIL STOCKPILE

Scale: NTS TEMPORARY

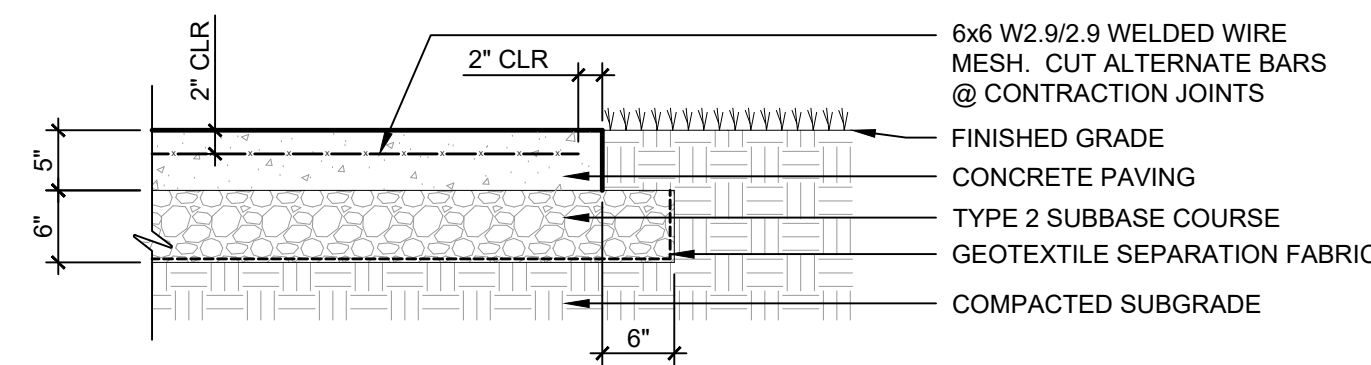


CONCRETE - WALK

Scale: NTS PEDESTRIAN TRAFFIC ONLY

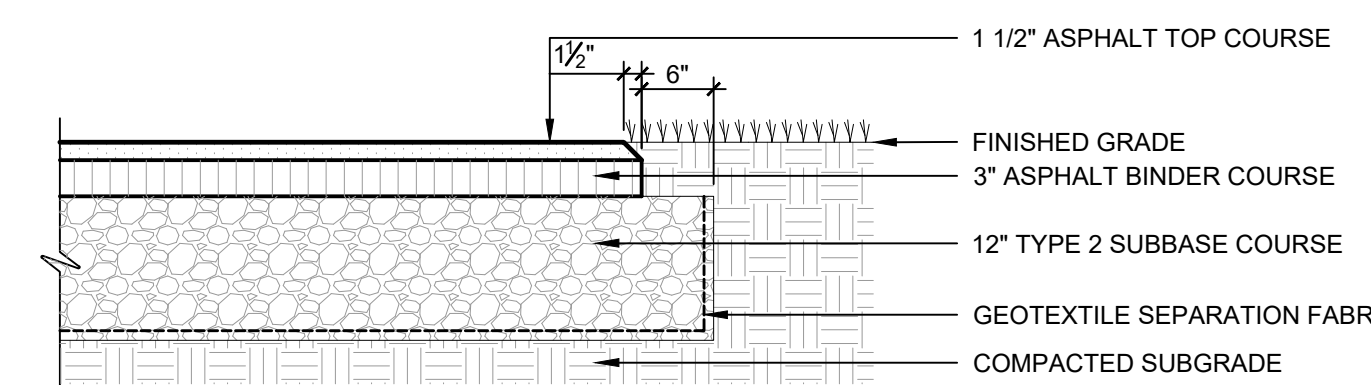


ASPHALT - PAVEMENT


Scale: NTS

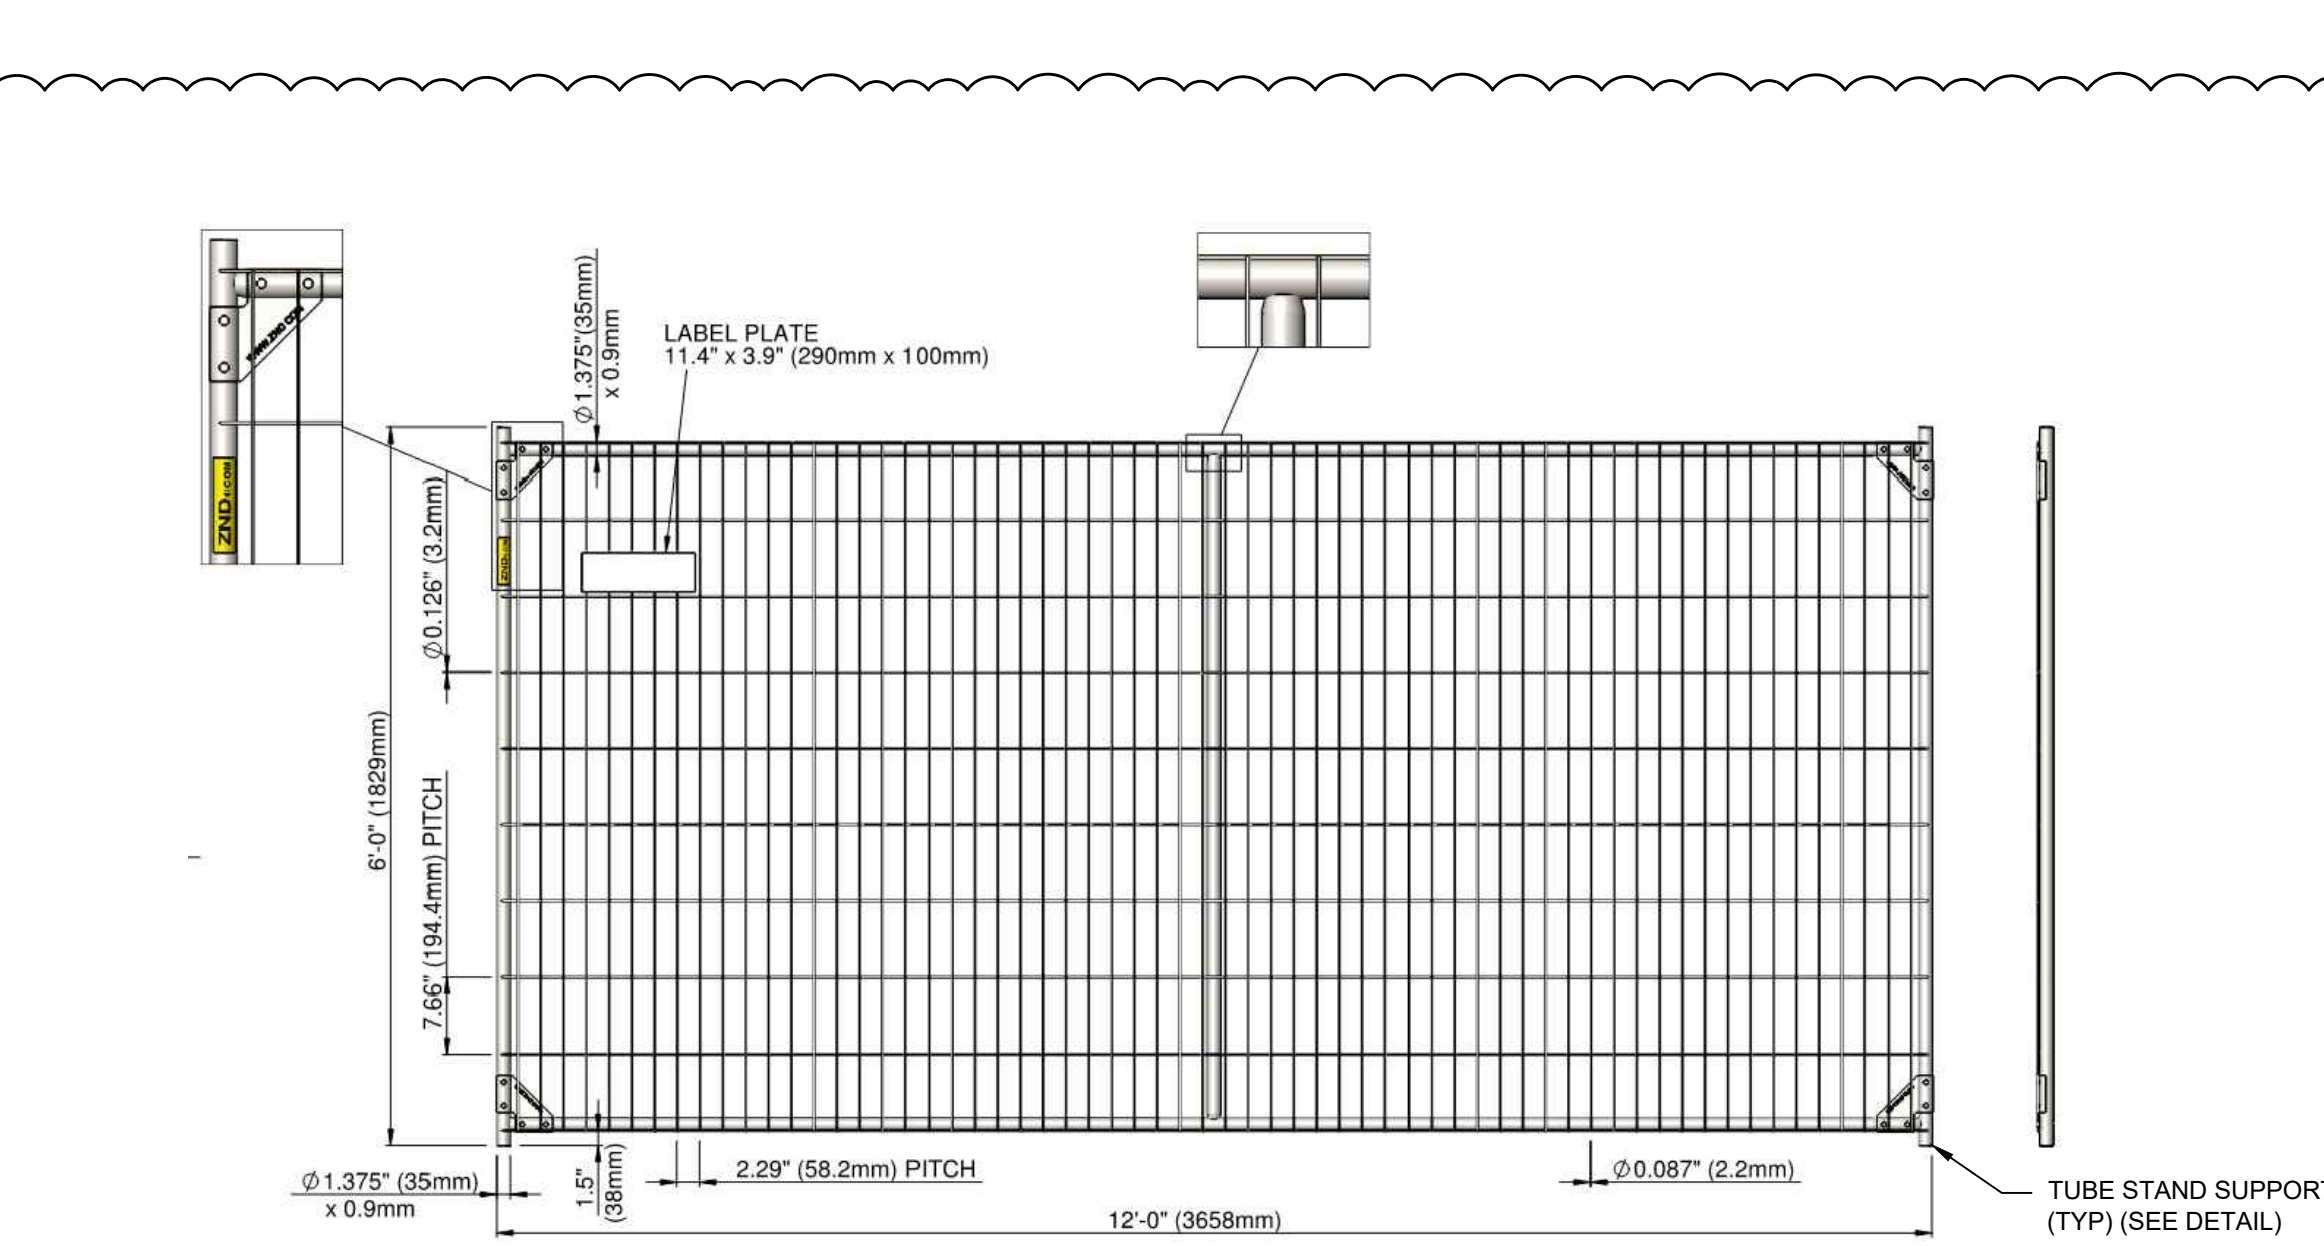

FENCE PANEL

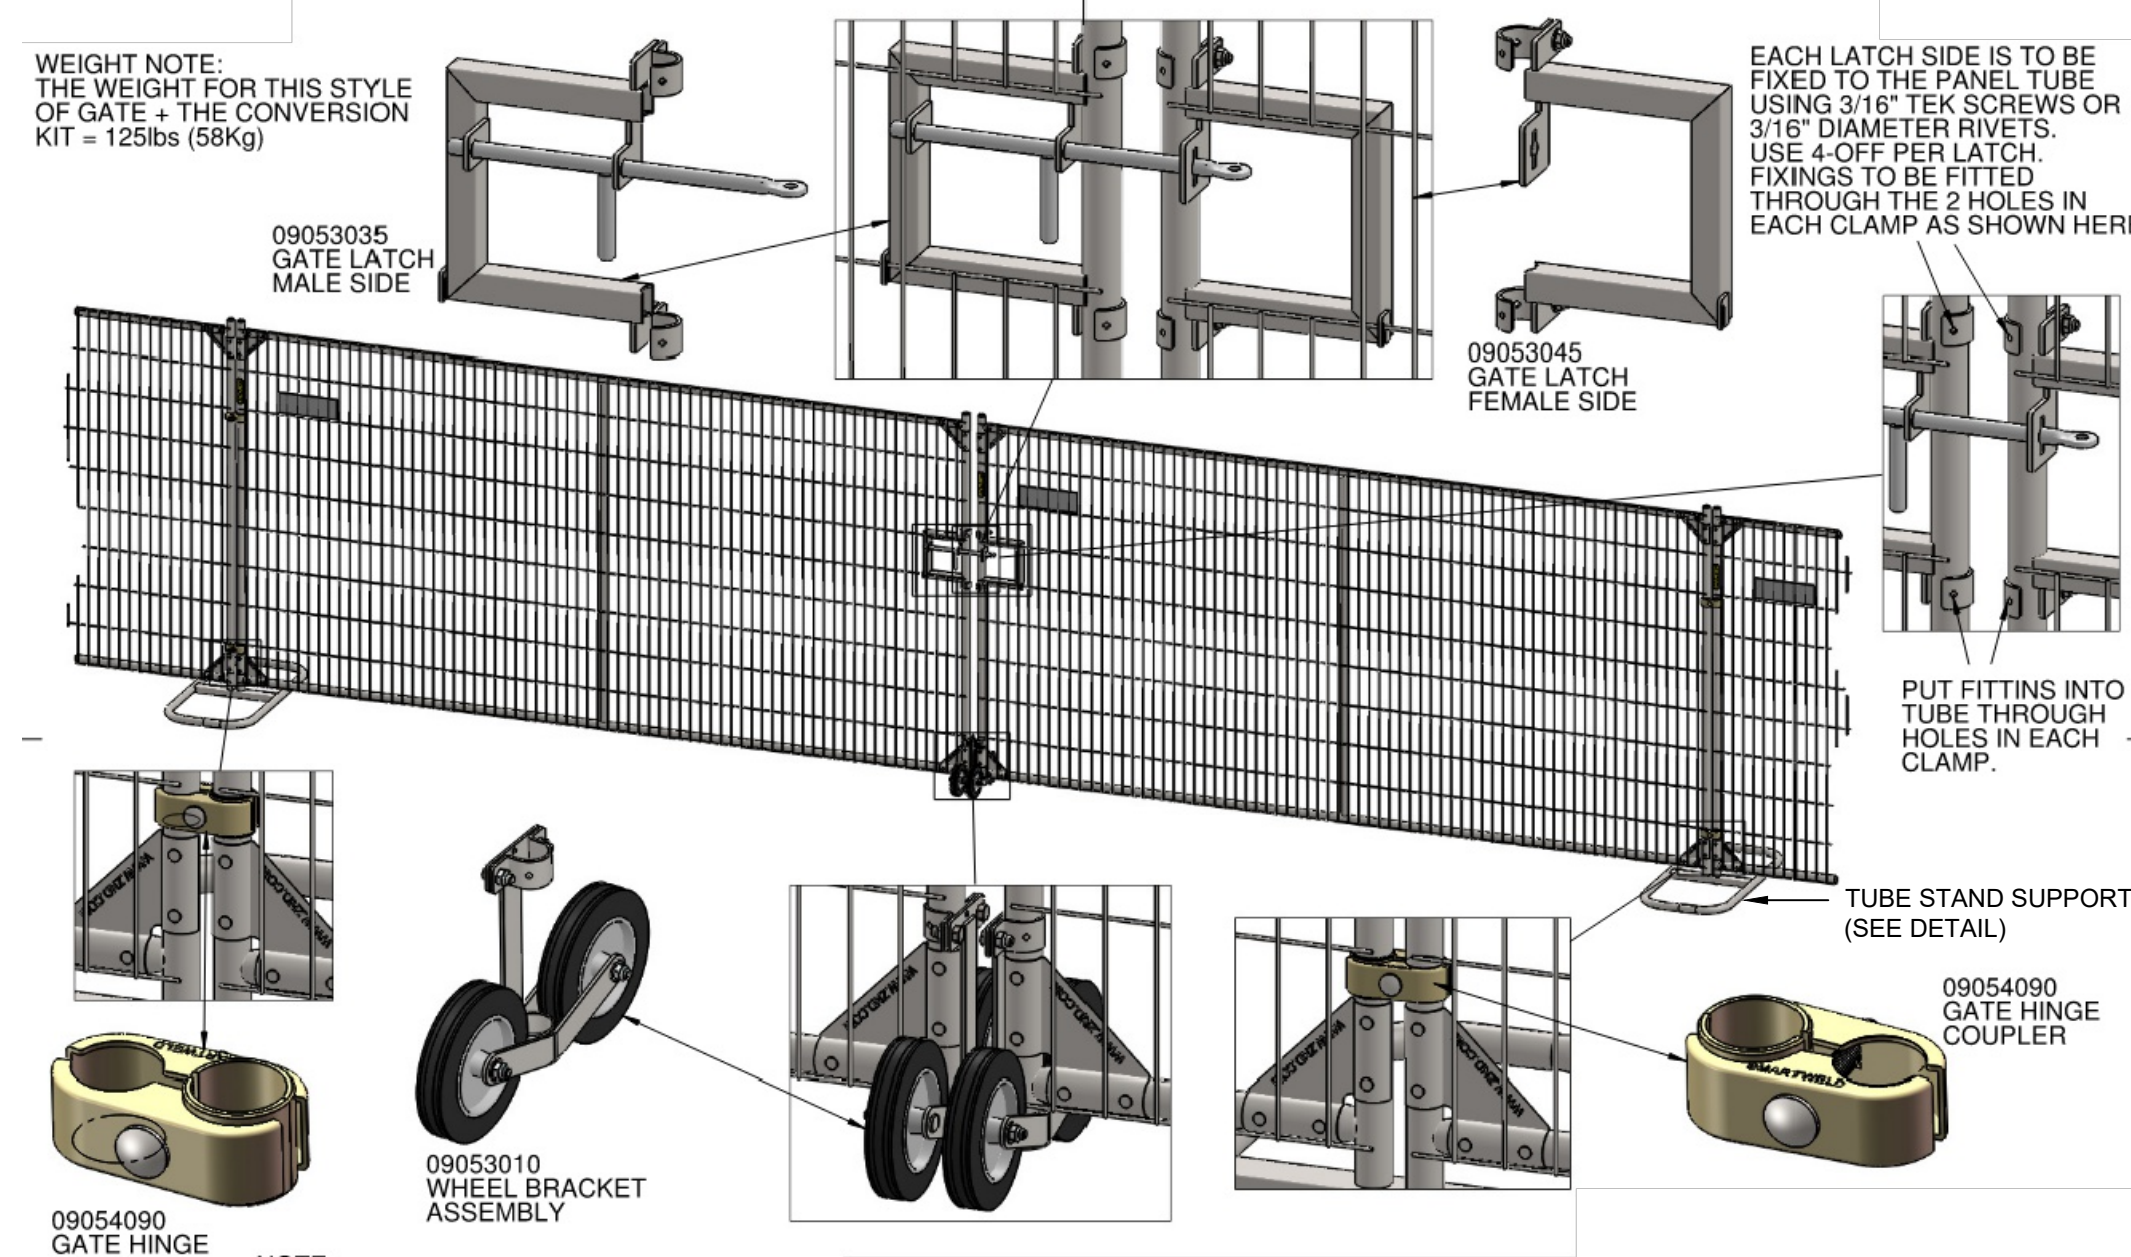

SWING GATE
24" WIDE DOUBLE LEAF

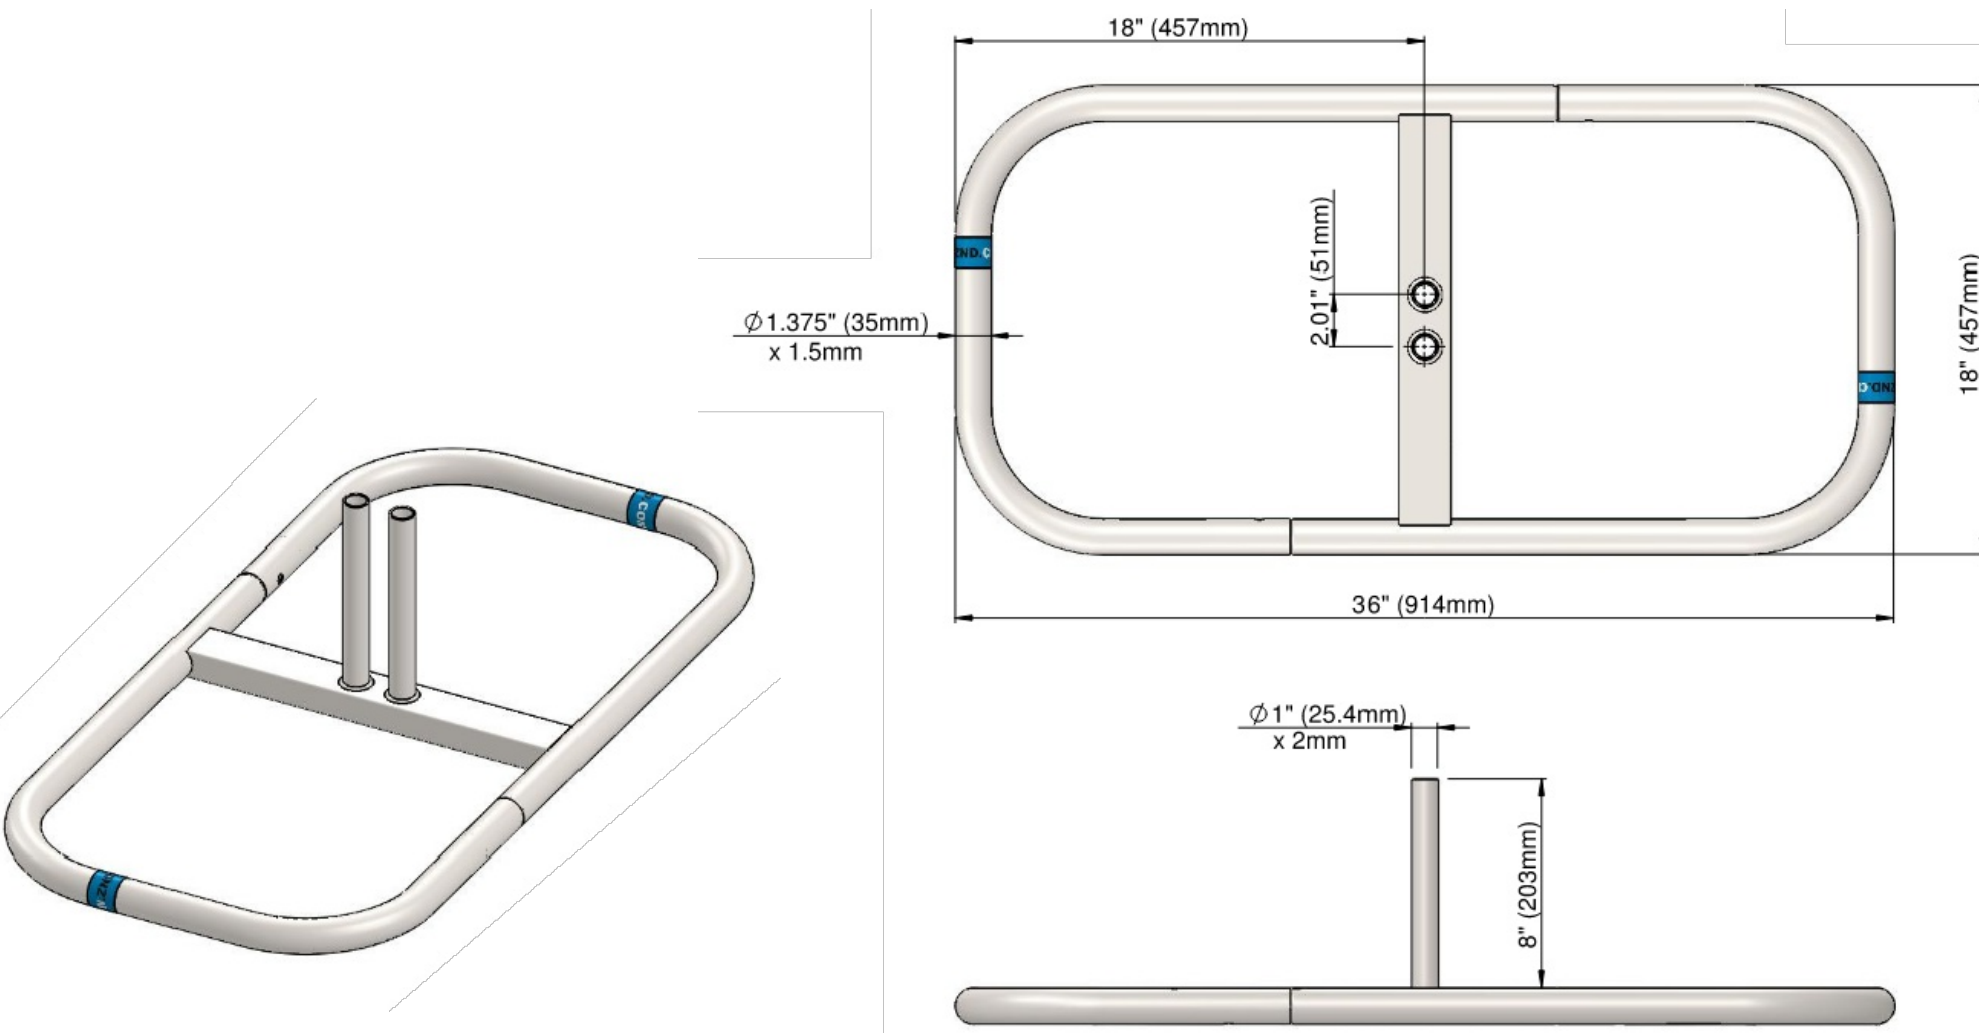

TUBE STAND SUPPORT

NOTES:

1. CONSTRUCTION FENCE AND GATE TO BE ANTICLIMB MESH.
2. CONSTRUCTION FENCE, GATE AND LEGS TO BE BARRIER HQ OR EQUAL.

TEMPORARY CONSTRUCTION FENCE AND GATE

Scale: NTS

CONSULTANT:

CERTIFICATE OF AUTHORIZATION # R 018342



CERTIFICATE OF AUTHORIZATION # R 002006




UNIFORM CODE STATEMENT:
TO THE BEST OF THE REGISTERED DESIGN PROFESSIONAL'S KNOWLEDGE, BELIEF, AND PROFESSIONAL JUDGEMENT, THESE PLANS AND/OR SPECIFICATIONS ARE IN COMPLIANCE WITH THE 2020 UNIFORM CODE.

ENERGY CODE COMPLIANCE STATEMENT:
TO THE BEST OF THE REGISTERED DESIGN PROFESSIONAL'S KNOWLEDGE, BELIEF, AND PROFESSIONAL JUDGEMENT, THESE PLANS AND/OR SPECIFICATIONS ARE IN COMPLIANCE WITH THE 2020 ENERGY CODE.

WARNING:
THE ALTERATION OF THIS MATERIAL, IN ANY WAY, UNLESS DONE UNDER THE DIRECTION OF A COMPARABLE PROFESSIONAL, I.E. ARCHITECT FOR AN ARCHITECT, ENGINEER FOR AN ENGINEER OR LANDSCAPE ARCHITECT FOR A LANDSCAPE ARCHITECT, IS A VIOLATION OF THE NEW YORK STATE EDUCATION LAW AND/OR REGULATIONS AND IS A CLASS 'A' MISDEMEANOR.



REGISTRATION EXPIRES 12/31/2028



CONSTRUCTION

TITLE:	PROVIDE BUILDING ENERGY EFFICIENCY IMPROVEMENTS
LOCATION:	DEC REGION 5 HEADQUARTERS 1115 NY-86 RAY BROOK, NY
CLIENT:	DEPARTMENT OF ENVIRONMENTAL CONSERVATION

PROJECT NUMBER:	47161-C
DESIGNED BY:	JLB
DRAWN BY:	JLB
FIELD CHECK:	ZR
APPROVED:	JH
SHEET TITLE:	SITE CIVIL DETAILS

SITE CIVIL DETAILS

DRAWING NUMBER:
C-601