



Office of General Services

DESIGN & CONSTRUCTION GROUP
THE GOVERNOR NELSON A. ROCKEFELLER
EMPIRE STATE PLAZA
ALBANY, NY 12242

ADDENDUM NO. 1 TO PROJECT NO. 47461

CONSTRUCTION, HVAC, PLUMBING AND ELECTRICAL WORK
REPLACE ROOFS, BUILDING 33, 34, 35, 39 & 66
INDUSTRY LIMITED SECURE CENTER
375 RUSH SCOTTSVILLE RD
RUSH, NY

January 3, 2025

<p>NOTE: This Addendum forms a part of the Contract Documents. Insert it in the Project Manual. Acknowledge receipt of this Addendum in the space provided on the Bid Form.</p>

CONSTRUCTION WORK DRAWINGS


1. Revised Drawing:
 - a. Drawing No. A-502, noted "REVISED DRAWING 01/02/2025" accompanies this Addendum and supersedes the same numbered originally issued drawing.

HVAC WORK DRAWINGS


2. Revised Drawing:
 - a. Drawing No. M-102, noted "REVISED DRAWING 01/02/2025" accompanies this Addendum and supersedes the same numbered originally issued drawing.

END OF ADDENDUM


Brady M. Sherlock, P.E.
Director, Division of Design
Design & Construction

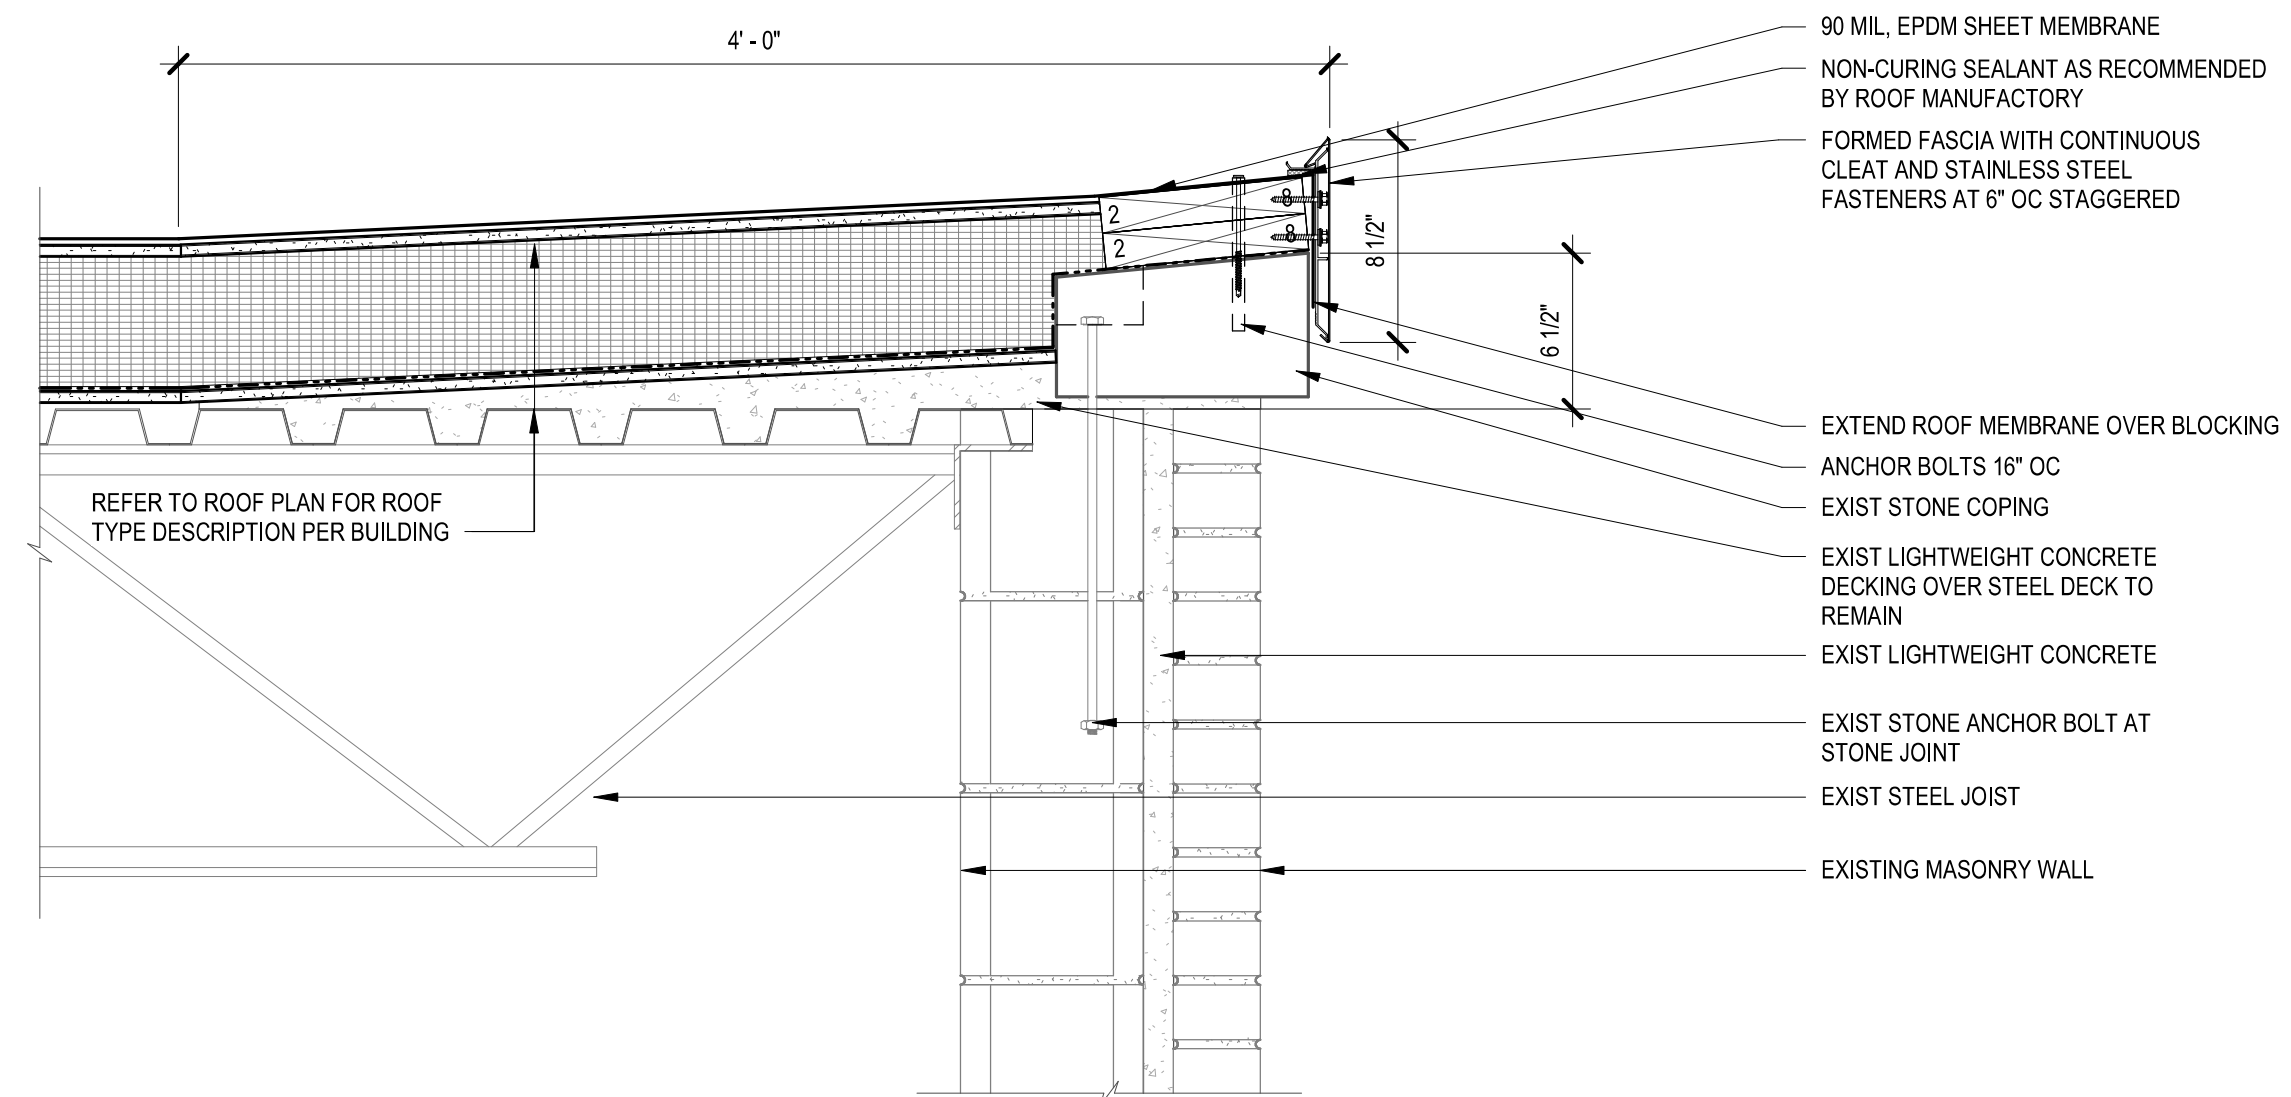

DETAIL - EDGE CONDITION ROOFS "B" AND "D"

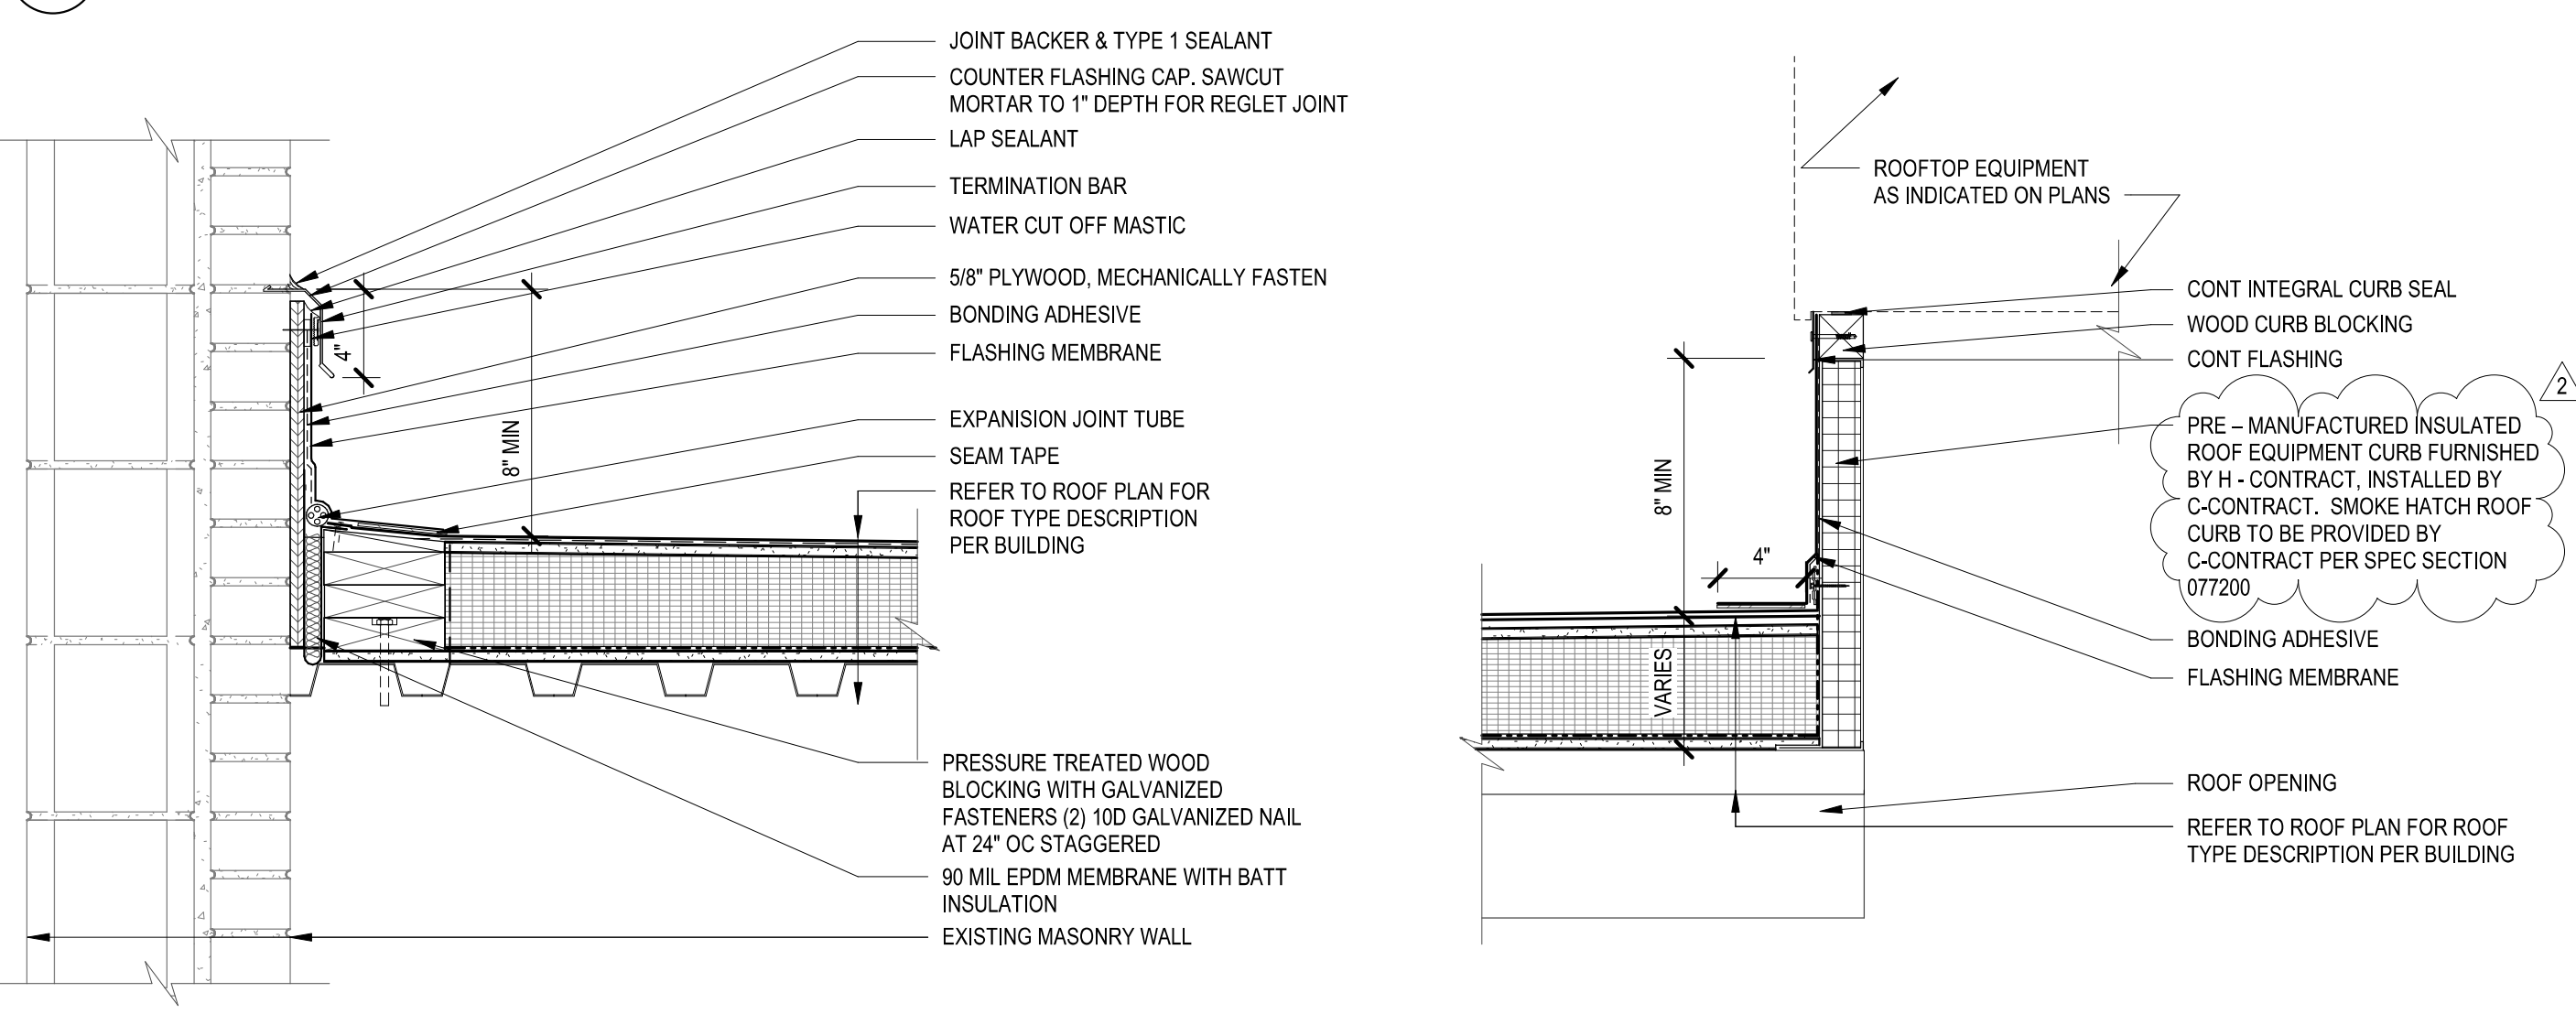

DETAIL - ROOF EQPM CURB

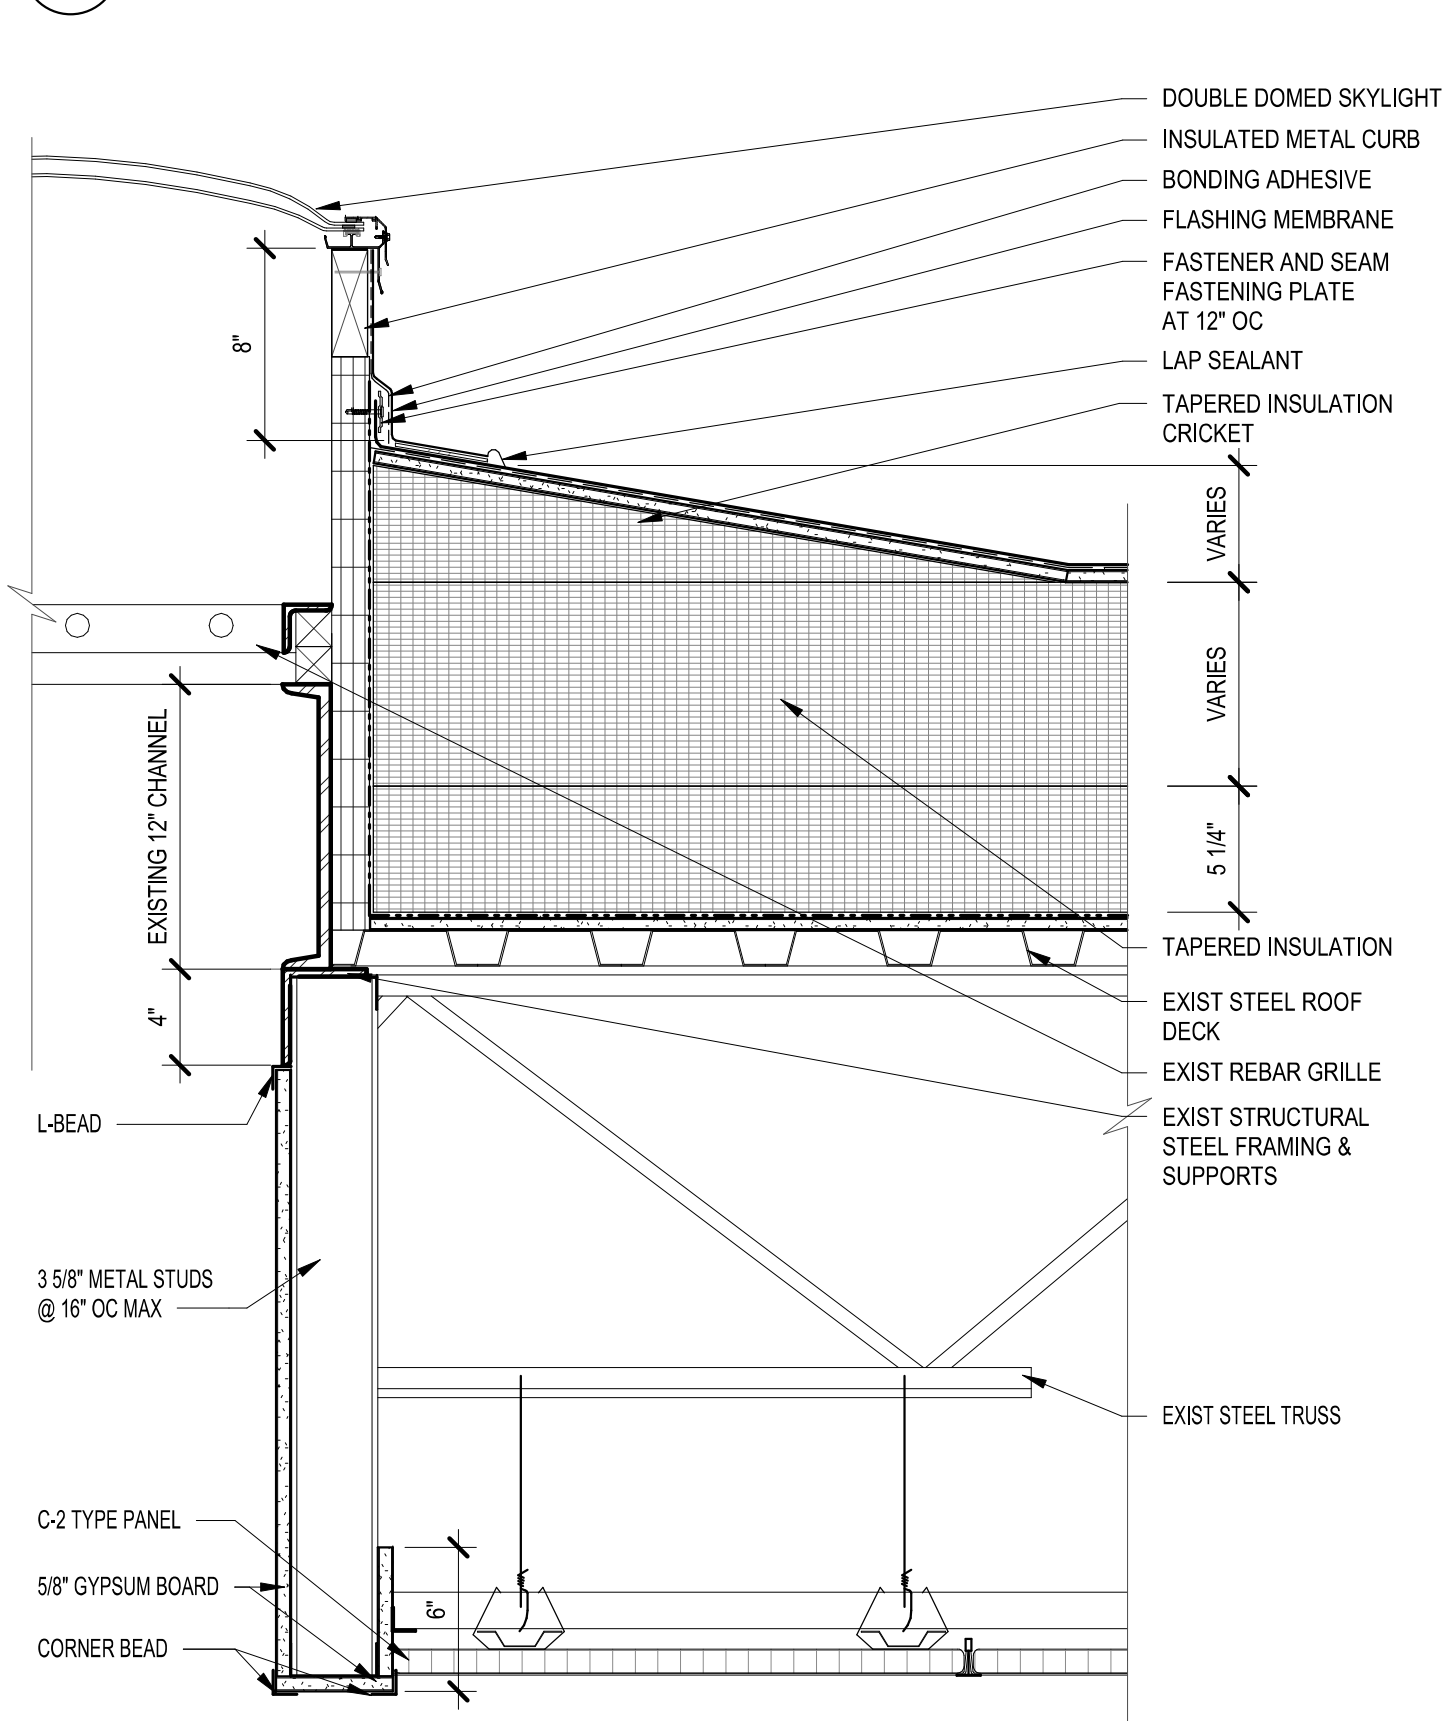


11
A-502


DETAIL - SKYLIGHT AT C-2

1 1/2" = 1'-0"




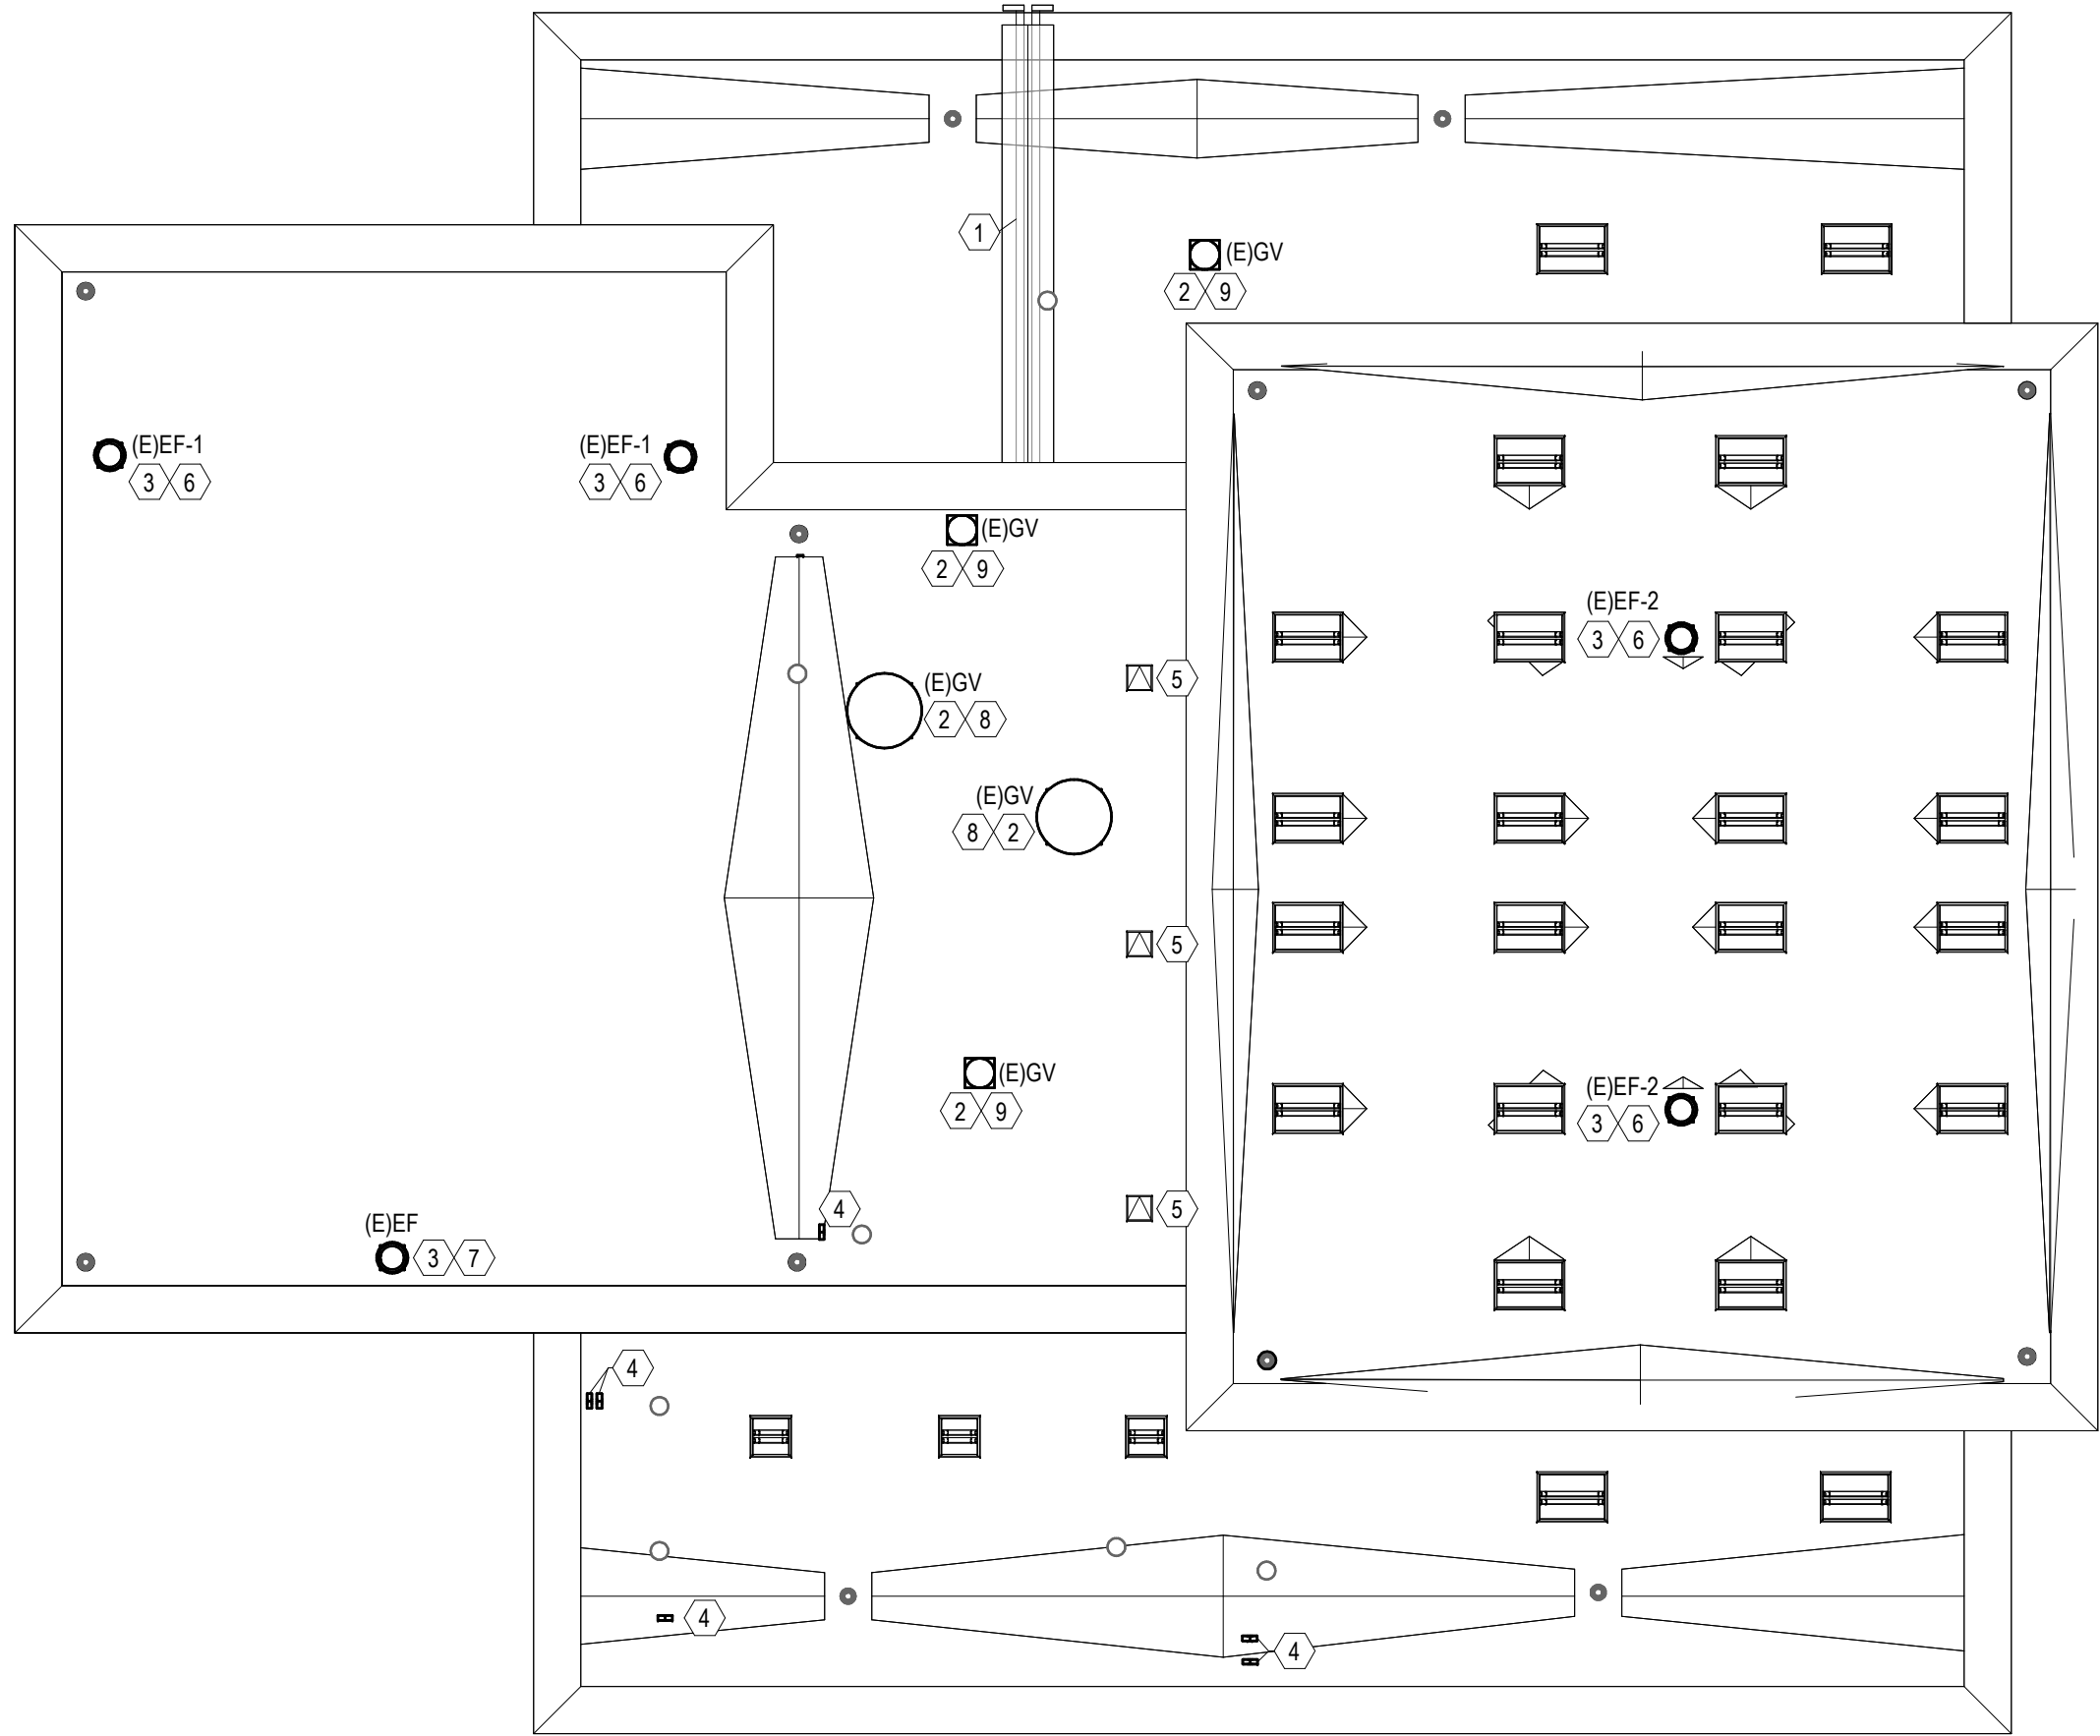

1 HVAC ROOF PLAN - BUILDING 66 NEW WORK
1/16" = 1'-0"

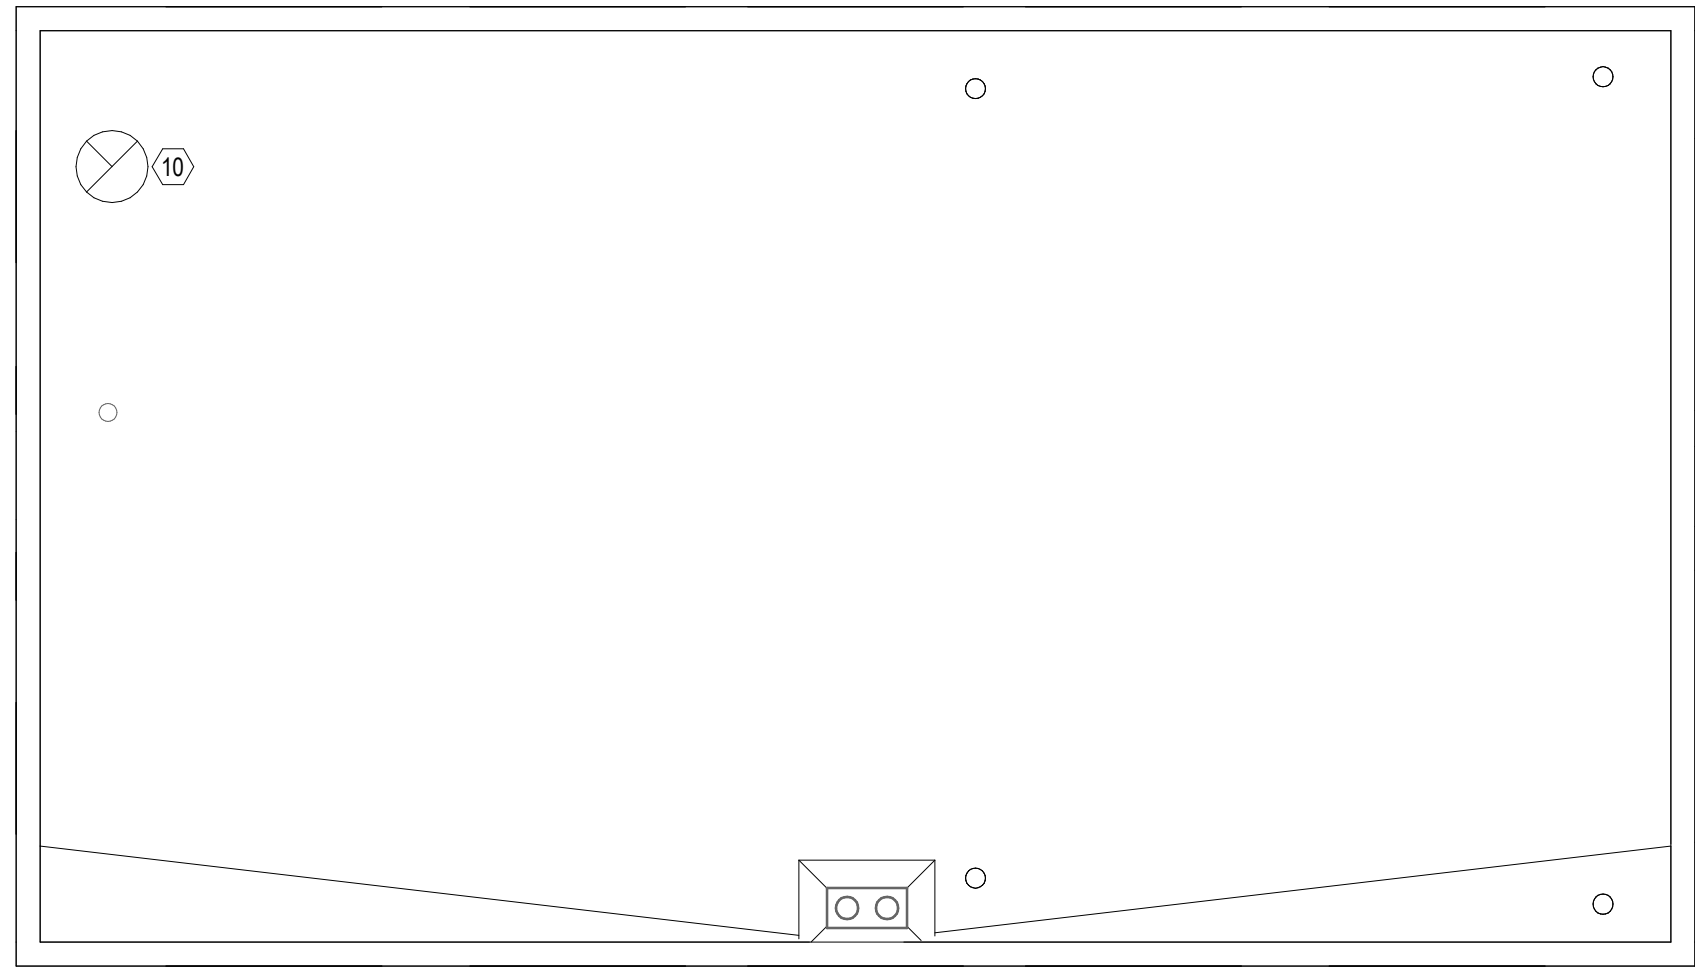

2 HVAC ROOF PLAN - BUILDING 35 NEW WORK
1/8" = 1'-0"

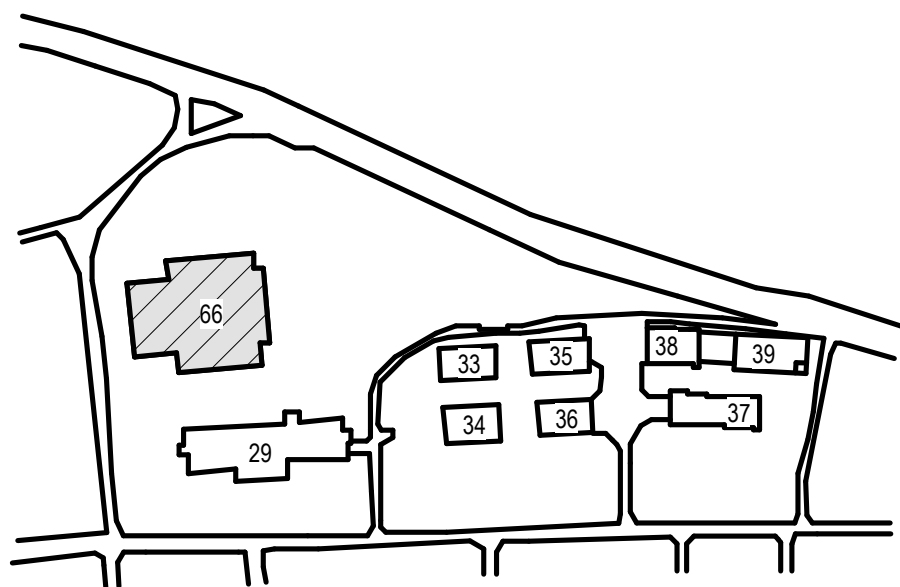

KEY PLAN
(NOT TO SCALE)

REVISED DRAWING 01/02/2025

NEW KEYNOTES

- EXISTING CONDUIT TO REMAIN.
- REINSTALL GRAVITY VENT. GRAVITY VENT INSTALLATION IS TO MATCH EXISTING CONDITIONS.
- REINSTALL EXHAUST FAN. EXHAUST FAN INSTALLATION IS TO MATCH EXISTING CONDITIONS. PROVIDE STARTUP AND TEST AND BALANCE SERVICES TO RE-ESTABLISH EXISTING FAN OPERATION AFTER REPLACEMENT.
- REINSTALL GOOSENECK OUTLET. PROVIDE ADDITIONAL DUCTWORK AS REQUIRED TO MAINTAIN EXISTING CONDITIONS. REFLASH OF EXHAUST OUTLETS AS REQUIRED BY C-CONTRACT. REFER TO DETAIL 3 ON M01.
- ROOF ACCESS SHOWN FOR REFERENCE.
- FURNISH INSULATED 44"x44"x30"H ROOF CURB AND TURN OVER TO C-CONTRACT FOR INSTALLATION. FIELD VERIFY REQUIRED CURB SIZE PRIOR TO ORDERING.
- FURNISH INSULATED 18"x18"x30"H ROOF CURB AND TURN OVER TO C-CONTRACT FOR INSTALLATION. FIELD VERIFY REQUIRED CURB SIZE PRIOR TO ORDERING.
- FURNISH INSULATED 56"x56"x30"H ROOF CURB AND TURN OVER TO C-CONTRACT FOR INSTALLATION. FIELD VERIFY REQUIRED CURB SIZE PRIOR TO ORDERING.
- FURNISH INSULATED 25"x25"x30"H ROOF CURB AND TURN OVER TO C-CONTRACT FOR INSTALLATION. FIELD VERIFY REQUIRED CURB SIZE PRIOR TO ORDERING.
- FURNISH GUY WIRES AND ANCHORS. C-CONTRACT TO INSTALL. GUY WIRE CABLE AND ATTACHMENT ASSEMBLIES SHALL HAVE UNIFORM MINIMUM BREAKING STRENGTH OF THE CABLE. SEVEN CABLE STRANDS, ZINC-COATED STEEL, COMPLYING WITH ASTM A475. BREAKING STRENGTH SHALL NOT BE LESS THAN 10,000 LBS. 12" ROOF ANCHOR AND ANCHOR ROD ASSEMBLIES OF HOT-DIP GALVANIZED STEEL. STRAIN INSULATORS OF EPOXY-BONDED FIBERGLASS OF LENGTH TO MEET CLEARANCE REQUIREMENTS. GUY MARKERS TO BE ROUND, VINYL OR PVC MATERIAL, WHITE IN COLOR AND SHATTER RESISTANT AT TEMP. BELOW 0 DEG F.

DESIGN & CONSTRUCTION

CONSULTANT:

CERTIFICATE OF AUTHORIZATION #: 0021331



UNIFORM CODE STATEMENT:


TO THE BEST OF THE REGISTERED DESIGN PROFESSIONAL'S KNOWLEDGE, BELIEF, AND PROFESSIONAL JUDGEMENT, THESE PLANS AND/OR SPECIFICATIONS ARE IN COMPLIANCE WITH THE 2020 UNIFORM CODE.

ENERGY CODE WRITTEN STATEMENT:

TO THE BEST OF THE REGISTERED DESIGN PROFESSIONAL'S KNOWLEDGE, BELIEF, AND PROFESSIONAL JUDGEMENT, THESE PLANS AND/OR SPECIFICATIONS ARE IN COMPLIANCE WITH THE 2020 ENERGY CODE.

WARNING:

THE ALTERATION OF THIS MATERIAL IN ANY WAY, UNLESS DONE UNDER THE DIRECTION OF A COMPARABLE PROFESSIONAL, I.E. ARCHITECT FOR AN ARCHITECT, ENGINEER FOR AN ENGINEER OR LANDSCAPE ARCHITECT FOR A LANDSCAPE ARCHITECT, IS A VIOLATION OF THE NEW YORK STATE EDUCATION LAW AND/OR REGULATIONS AND IS A CLASS A MISDEMEANOR.



EXPIRATION: 7/31/2026

CONTRACT:

HVAC

TITLE:

REPLACE ROOFS,
BUILDINGS 33, 34, 35, 39, AND 66

LOCATION:

INDUSTRY RESIDENTIAL CENTER
375 RUSH SCOTTSVILLE ROAD
RUSH, NY

CLIENT:

OFFICE OF CHILD AND FAMILY
SERVICES

2	01/02/2025	Addendum 01
1	10/25/2024	Bid Document
MARK	DATE	DESCRIPTION
PROJECT NUMBER:	47461 - H	
DESIGNED BY:	HG	
DRAWN BY:	HG	
FIELD CHECK:		
APPROVED:		
SHEET TITLE:		

ROOF PLAN - BUILDING 66 AND
BUILDING 35

DRAWING NUMBER:

M-102

SHEET 39

OF 66